



أبو غالي
abou ghaly
للصناعات البلاستيكية



INTEGRATED PLUMBING SYSTEM
U.P.V.C PIPES & FITTINGS



aboughaly
For Plastic Industries



أبو غالي
abou ghaly

aboughaly ®/ U.P.V.C Pipes and fittings / Technical Catalogue / Made in Egypt

كلمة رئيس مجلس الإدارة



إنه لمن دواعي سروري أن أتقدم الى أسرة شركة أبو غالى للصناعات البلاستيكية وعملائها الكرام بكل الحب والترحيب حامدًا الله تعالى أن وفقنا الى مآحن عليه أملا فى مزيد من النجاح والتقدم والأزدهار وموقنا اننا أسرة شركة أبو غالى لسنا وحدنا اصحاب النجاح بل يشاركنا فيه كل من تعامل معنا أو سمع عنا ولهم جميعا منا كل الحب والعرفان والتقدير

رئيس مجلس الادارة
محمد السيد غالي

Contents

| | |
|---|----|
| INTRODUCTION..... | 1 |
| PROPERTIES AND BENEFITS..... | 1 |
| MANUFACTURE..... | 3 |
| QUALITY ASSURANCE | 5 |
| MATERIAL PROPERTIES..... | 6 |
| CHEMICAL RESISTANCE OF PVC | 7 |
| EXPANSION AND CONTRACTION | 13 |
| SOLVENT WELDING UPVC PIPES and FITTINGS | 14 |
| UPVC PIPES & FITTINGS DIAGRAMS | 16 |
| STANDARDS & REGULATIONS..... | 17 |
| JUMPO PRODUCTS | 19 |
| TRANSPORT, HANDLING & STORAGE..... | 34 |
| CERTIFICATES | 37 |

INTRODUCTION

ABOU GHALY have been relentless in its commitment to quality and service. Through the years, **ABOU GHALY** have broadened and enhanced its product line to serve better to the customers. **ABOU GHALY** is very proud to introduce pressure pipe and conventional drainage system for soil waste and rain water under the brand name **«JUMPO» «GPF»** for non-pressure plumbing applications is manufactured from high quality PVC polymer.

ABOU GHALY UPVC pipes and fittings are light weight, easy to install and are made for life time trouble free service.

They are available in full range from ½ " to 8 ". The entire range is manufactured as per internationally accepted quality standards and specifications.

«JUMPO» «GPF» fittings are available in grooved pasting type in full range starting from ½ " to 6 " and are fully compatible with **«JUMPO» «GPF»** Pipes.



PROPERTIES AND BENEFITS

STRONGER, RESILIENT & LIGHT WEIGHT

ABOU GHALY system is highly resilient and tough with good mechanical strength and high impact resistance. At the same time this system is very light in weight which gives highest benefit to the end user in terms of transportation, installation and long service life.

CORROSION RESISTANCE

The inert nature of UPVC system provides complete corrosion resistance and renders wrapping, coating and lining unnecessary. It also ensures that UPVC pipes have long operational life compared to conventional cast iron systems.

NON-CONDUCTIVE

UPVC is a non conductive of electricity, and is therefore not subject to galvanic or electrolytic action.

FLAMMABILITY

UPVC does not support combustion and is inherently difficult to ignite. It also stops burning once the source of heat is removed.

CHEMICAL RESISTANCE

ABOU GHALY UPVC system is inert to most of the acids, alkalis, effluents, salts, minerals and aggressive soils. The system remains unaffected by transportation of such type of media and gives longer life with trouble free service.

UV STABILIZED

ABOU GHALY systems is UV stabilized which gives protection to the system while being operational in direct sunlight.

HIGH FLOW RATES

Extremely smooth bores, precision joints and lack of internal projections ensure unrivaled hydraulic capacity over the total life of the system. Flatter gradients can be possible using ABOU GHALY **«JUMPO» «GPF»** UPVC systems over conventional systems.

VERSATILE AND ELEGANT

The physical properties of PVC allow designers a high degree of freedom while designing. Superior finished pipes and fittings add a touch of beauty to the buildings and keeping far from looking unsightly.

QUICK & EASY INSTALLATIONS

ABOU GHALY **«JUMPO» «GPF»** pipes and fittings can be joined together with rubber ring Or solvent weld system.

These techniques are very simple and ensure 100% leak proof system at a reduced installation time with lower maintenance.

Leakages due to broken and cracked elements in the system and joint opening within traditional systems like Cast iron & asbestos are eliminated by precision joint and sealed access points provided by the UPVC sewer pipe and fitting system.

PRODUCT SPECIFICATION

Pipes and fittings of ABOU GHALY'JUMPO' system is produced in the following sizes: ½ " to 8 ".

MANUFACTURE


Basically, PVC products are formed from raw PVC powder by a process of heat and pressure. The two major processes used in manufacture are extrusion for pipe and injection moulding for fittings.

Modern PVC processing involves highly developed scientific methods requiring precise control over process variables.

The polymer material is a free-flowing powder, which requires the addition of stabilizers and processing aids.

Formulation and blending are critical stages of the process and tight specifications are maintained for incoming raw materials, batching and mixing.

Feed to the extrusion or moulding machines may be direct, in the form of "dry blend", or pre-processed into a granular "compound".

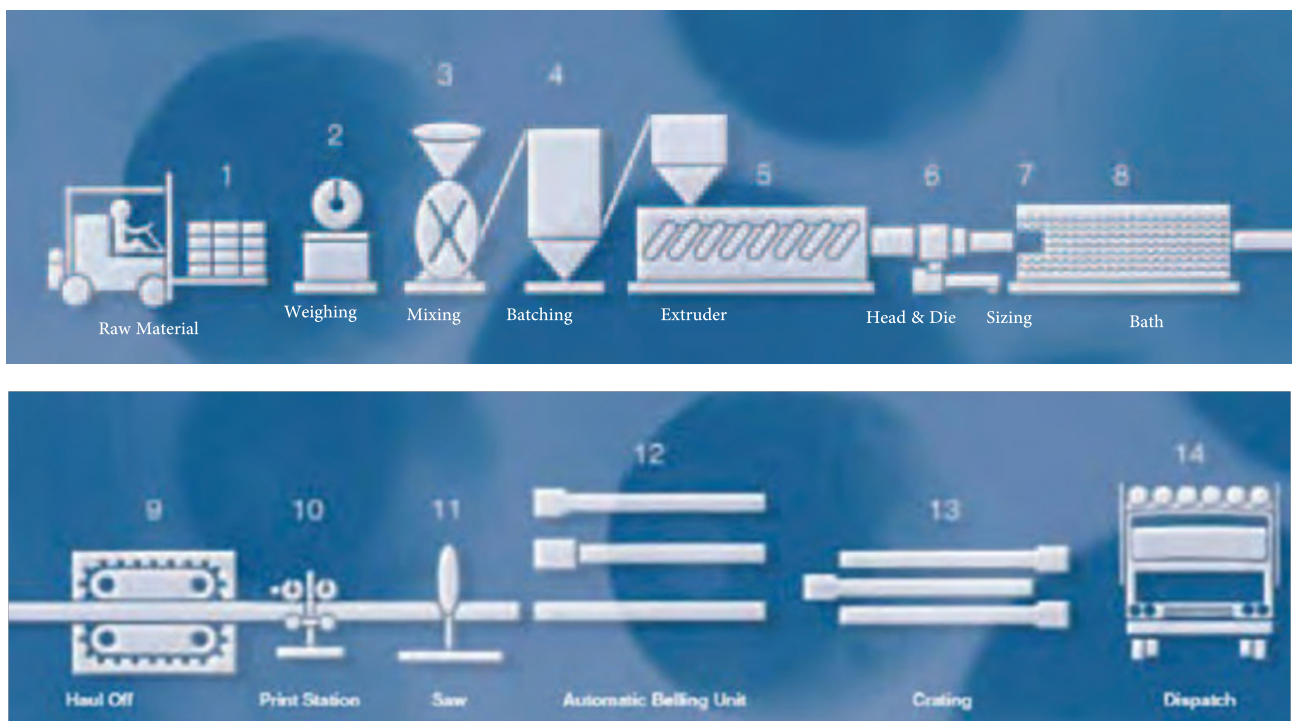

Extrusion

(Figure 1.1)

Polymer and additives are accurately weighed and processed through the high-speed mixing to blend the raw materials into a uniformly distributed dry blend mixture. A mixing temperature of around 120°C is achieved by frictional heat.

At various stages of the mixing process, the additives melt and progressively coat the PVC polymer granules.

After reaching the required temperature, the blend is automatically discharged into a cooling chamber which rapidly reduces the temperature to around 50°C, thereby allowing the blend to be conveyed to intermediate storage where even temperature and density consistency are achieved.

The heart of the process, the extruder has a temperature-controlled, zoned barrel in which rotate precision “screws”.

Modern extruder screws are complex devices, carefully designed with varying flights to control the compression and shear, developed in the material, during all stages of the process. The twin counter-rotating screw configuration used by all major manufacturers offers improved processing.

The PVC dry blend is metered into the barrel


and screws, which then convert the dry blend into the required “melt” state, by heat, pressure and shear. During its passage along the screws, the PVC passes through a number of zones that compress, homogenies and vent the melt stream.

The final zone increases the pressure to extrude the melt through the head and die set which is shaped according to the size of the pipe required and flow characteristics of the melt stream. Once the pipe leaves the extrusion die, it is sized by passing through a precision sizing sleeve with external vacuum.

This is sufficient to harden the exterior layer of PVC and hold the pipe diameter during final cooling in a controlled water cooling chambers.

The pipe is pulled through the sizing and cooling operations by the puller or haul-off at a constant speed. Speed control is very important when this equipment is used because the speed at which the pipe is pulled will affect the wall thickness of the finished product. In the case of rubber ring jointed pipe the haul-off is slowed down at appropriate intervals to thicken the pipe in the area of the socket.

An in-line printer marks the pipes at regular intervals, with identification according to size,

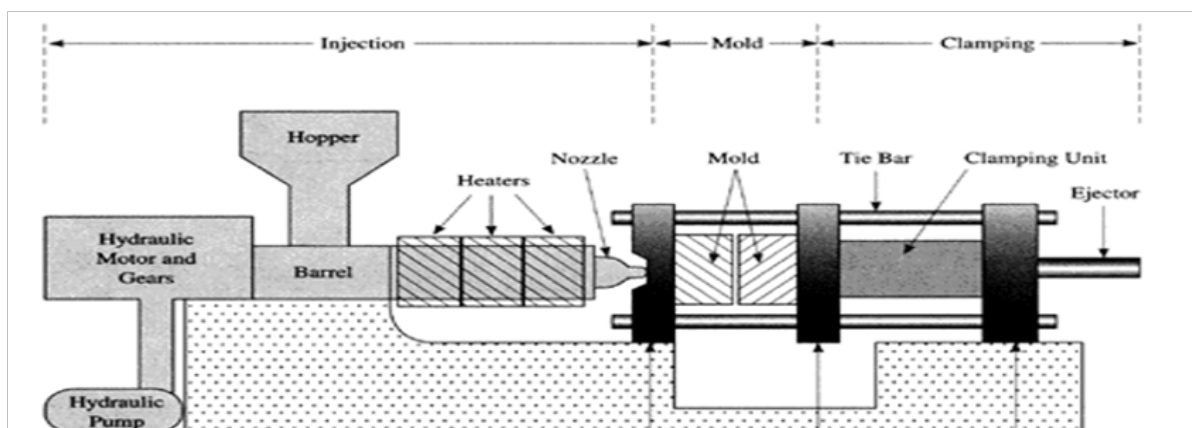

class, type, date, Standard number, and extruder number.

An automatic cut-off saw cuts the pipe to the required length.

A bellling machine forms a socket on the end of each length of pipe.

There are two general forms of socket. For rubber-ring jointed pipe, a collapsible mandrel is used, whereas a plain mandrel is used for solvent jointed sockets. Rubber ring pipe requires a chamfer on the spigot, which is executed either at the saw station or bellling unit.

Injection Molding

PVC fittings are manufactured by high-pressure injection molding. In contrast to continuous extrusion, molding is a repetitive cyclic process, where a “shot” of material is delivered to a mold in each cycle.

PVC material, either in dry blend powder form or granular compound form, is gravity fed from a hopper situated above the injection unit, into the barrel housing a reciprocating screw.

The barrel is charged with the required amount of plastic by the screw rotating and conveying the material to the front of the barrel. The position of the screw is set to a predetermined “shot size”. During this action, pressure and heat “plasticize” the material, which now in its melted state, awaits injection into the mold.

All this takes place during the cooling cycle of

The finished product is stored in holding areas for inspection and final laboratory testing and quality acceptance.

All production is tested and inspected in accordance with the appropriate Standards and/or to specifications of the purchaser.

After inspection and acceptance, the pipe is stored to await final dispatch.

the previous shot.

After a preset time, the mold will open and the finished molded fitting will be ejected from the mold.

The mold then closes and the melted plastic in the front of the barrel is injected under high pressure by the screw now acting as a plunger. The plastic enters the mold to form the next fitting.

After injection, recharge commences while the molded fitting goes through its cooling cycle.

QUALITY ASSURANCE

ABOU GHALY is committed to the philosophy of Total Quality Management. All ABOU GHALY manufacturing sites are certified to ISO 9001, OHSAS 18001 “Quality Management systems- Model for quality assurance in production, installation and servicing.” ABOU GHALY was the first PVC pipe manufacturer in EGYPT to

be awarded the prestigious Standards Mark

product certification. Since that time, Standards Mark certification has been achieved by ABOU GHALY for products to various Egyptian and American Standards

From the raw materials entering the factory to the delivery of the finished product, the ABOU GHALY emphasis on quality and customer service ensures performance that exceeds the requirements of industry and standards.

All raw materials for ABOU GHALY products must meet detailed specifications and suppliers are required to conform to strict quality assurance standards.

Production processes are enumerated, closely specified and continuously monitored and

recorded. Inspection and control are exercised by properly trained personnel using calibrated equipment.

MATERIAL PROPERTIES

MATERIAL

Unplasticized Polyvinyl Chloride (UPVC)

| General Properties | | UPVC VALUE | | UNITS |
|--|------------------------|-------------------|--------------------|-------|
| Density | 1.38 | | g/cm ³ | |
| Water absorption | <4 | | mg/cm ² | |
| Flammability | Self extinguishing | | | |
| Mechanical Properties | | | | |
| Ultimate Tensile Strength | 492 | | Kg/cm ² | |
| Compressive Strength | 668 | | Kg/cm ² | |
| Flexural Strength | 950 | | Kg/cm ² | |
| Modulus of Elasticity | 2.7x10 ⁴ | | Kg/cm ² | |
| Impact Strength (Charpy) | No Break> 10% | | | |
| Shore Hardness (Rockwell) | 115 | | R | |
| Thermal Properties | | | | |
| Softening Point | | | | |
| v.s.t. 5 Kg | Pipes ≥79° | Fittings ≥ 76° | °c | |
| Max. Operating temperature | 60 | | °c | |
| Coefficient of Thermal Expansion | 3.0 x 10 ⁻⁵ | | In/In/°F | |
| Specific Heat | 0.25 | | Cal/g . °c | |
| Thermal Conductivity | 0.13 | | Kcal/m.h. °c | |
| Electrical Properties | | | | |
| Volume Resistivity | >10 ¹⁴ | | Ohm.cm | |
| Surface Resistance | >10 ¹² | | Ohm | |
| Dielectric Strength | >40 | | Kv/mm | |
| Power Factor (at 10 ⁶ cycle) | 3.3 | | | |

Note: All the above-mentioned values at 20°C.

Product Testing

Products are examined and tested to ensure compliance with the relevant Egyptian and American Standard. Pipe production is fully traceable and test results are recorded for all extrusion and molded products

The tests specified in Egyptian and American Standards can be divided into two main categories, type tests and quality control tests. Type tests are tests that are carried out to verify the acceptability of a formulation, process or product design.

They are repeated whenever any of these factors changes. Dimensional checks and quality control tests are routinely conducted at regular intervals during production.

- Effect on water - This is a series of type tests carried out in order to demonstrate that the pipe or fitting does not have a detrimental effect on the quality of drinking water.

It assesses the effect of the pipe or fittings on the taste, odor and appearance of water as well as the health aspects due to growth of microorganisms and leaching of toxic substances

- Vinyl chloride monomer test- This requirement is to ensure that the residual VCM in PVC material does not exceed safe limits

- Light transmission tests
 - This test is conducted to ensure that PVC pipes have sufficient opacity to prevent growth of algae in the water conveyed. It is a type test for a given formulation and pipe wall thickness

- Joint pressure and infiltration tests
 - Elastomeric ring joints are subjected to both an internal hydrostatic pressure test and an external pressure or internal vacuum test in order to ensure a satisfactory joint design.

Chemical Resistance of PVC

Important Information

The listed data are based on results of immersion tests on specimens, in the absence of any applied stress. In certain circumstances, where the preliminary classification indicates high or limited resistance, it may be necessary to conduct further tests to assess the behavior of pipes and fittings under internal pressure or other stresses.

Variations in the analysis of the chemical compounds as well as in the operating conditions (pressure and temperature) can significantly modify the actual chemical resistance of the materials in comparison with this chart indicated value.

It should be stressed that these ratings are intended only as a guide to be used for initial information on the material to be selected. They may not cover the particular application under consideration and the effects of altered temperatures or concentrations may need to be evaluated by testing under specific conditions. No guarantee can be given in respect of the listed data. ABOU GHALY reserves the right to make any modification whatsoever, based upon further research and experiences.

Sources for Chemical Resistances of PVC

Source 1

ISO/TR 10358 Technical Report: Plastic Pipes and Fittings-Combined Chemical-resistance Classification Table, First Edition, International Organization for Standardization, 1993.

Source 2

Chemical Resistance, Volume 1- Thermoplastics, Second Edition, Plastics Design Library, 1994.

Abbreviations:

S Satisfactory Resistance

L LimitedResistance

U Unsatisfactory Resistance

dil.sol. dilute aqueous solution at a concentration equal to or less than 10%

sol. Aqueous solutionataconcentration greater then10% but not saturated

sat.sol. saturated aqueous solution prepared at 20°C

tg-g technicalgrade,gas

tg-l technicalgrade,liquid

tg-s technicalgrade,solid

work.sol. working solutionofthe concentrationusually used in the industry concerned

susp. Suspension of solid in a saturated solution at 20°C



| Chemical | Formula | Conc. (%) | Temp. (°C) | uPVC |
|--------------------|--|------------------|------------|------|
| ACETALDEHYDE | CH ₃ CHO | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| - AQUEOUS SOLUTION | | 40 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| ACETIC ACID | CH ₃ COOH | ≤25 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 30 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 60 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 80 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| - GLACIAL | | 100 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| ACETIC ANHYDRIDE | (CH ₃ CO) ₂ O | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| ACETONE | CH ₃ COCH ₃ | 10 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| | | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| ACETOPHENONE | CH ₃ COC ₆ H ₅ | nd | 25 | |
| | | | 60 | |
| | | | 100 | |
| ACRYLONITRILE | CH ₂ CHCN | technically pure | 25 | |
| | | | 60 | 3 |
| | | | 100 | |
| ADIPIC ACID | (CH ₂ CH ₂ CO ₂ H) ₂ | sat. | 25 | 1 |
| - AQUEOUS SOLUTION | | | 60 | 2 |
| | | | 100 | |
| ALLYL ALCOHOL | CH ₂ CHCH ₂ OH | 96 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| ALUM | Al ₂ (SO ₄) ₃ .K ₂ SO ₄ .nH ₂ O | dil | 25 | 1 |
| - AQUEOUS SOLUTION | | | 60 | 2 |
| | | | 100 | |
| | Al ₂ (SO ₄) ₃ .K ₂ SO ₄ .nH ₂ O | sat | 25 | |
| | | | 60 | 2 |
| | | | 100 | |
| ALUMINIUM | AlCl ₃ | all | 25 | 1 |
| - CHLORIDE | | | 60 | 1 |
| | | | 100 | |
| - FLUORIDE | AlF ₃ | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - HYDROXIDE | Al(OH) ₃ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - NITRATE | Al(NO ₃) ₃ | nd | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - SULPHATE | Al(SO ₄) ₃ | deb | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| | | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |

| Chemical | Formula | Conc. (%) | Temp. (°C) | uPVC |
|---------------------|---|-----------|------------|------|
| AMMONIA | NH ₃ | deb | 25 | 1 |
| - AQUEOUS SOLUTION | | | 60 | 2 |
| | | | 100 | |
| | | sat | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| - DRY GAS | | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - LIQUID | | 100 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| AMMONIUM | CH ₃ COONH ₄ | sat | 25 | |
| - ACETATE | | | 60 | 2 |
| | | | 100 | |
| - CARBONATE | (NH ₄) ₂ CO ₃ | all | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| - CHLORIDE | NH ₄ Cl | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - FLUORIDE | NH ₄ F | 25 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| - HYDROXIDE | NH ₄ OH | 28 | 25 | |
| | | | 60 | 2 |
| | | | 100 | |
| - NITRATE | NH ₄ NO ₃ | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - PHOSPHATE DIBASIC | NH ₄ (HPO ₄) ₂ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - PHOSPHATE META | (NH ₄) ₄ P ₄ O ₁₂ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - PHOSPHATE TRI | (NH ₄) ₂ HPO ₄ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - PERSULPHATE | (NH ₄) ₂ S ₂ O ₈ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - SULPHIDE | (NH ₄) ₂ S | deb | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - SULPHYDRATE | NH ₄ OHSO ₄ | dil | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| AMYLACETATE | CH ₃ CO ₂ CH ₂ (CH ₂) ₃ CH ₃ | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| AMYLALCOHOL | CH ₃ (CH ₂) ₄ CH ₂ OH | nd | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| ANILINE | C ₆ H ₅ NH ₂ | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| - CHLORHYDRATE | C ₆ H ₅ NH ₂ HCl | nd | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |

| Chemical | Formula | Conc. (%) | Temp. (°C) | uPVC |
|----------------|--|------------------|------------|------|
| ANTIMONY | SbCl ₃ | 100 | 25 | 1 |
| - TRICHLORIDE | | | 60 | 1 |
| | | | 100 | |
| ANTHRAQUINONE | | suspension | 25 | 1 |
| SULPHONIC ACID | | | 60 | 2 |
| | | | 100 | |
| AQUA REGIA | HC+HNO ₃ | 100 | 25 | 2 |
| | | | 60 | 2 |
| | | | 100 | |
| ARSENIC ACID | H ₃ AsO ₄ | deb | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 80 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| BARIUM | | all | 25 | 1 |
| - CARBONATE | BaCO ₃ | | 60 | 1 |
| | | | 100 | |
| - CHLORIDE | BaCl ₂ | 10 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - HYDROXIDE | Ba(OH) ₂ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - SULPHATE | BaSO ₄ | nb | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - SULPHIDE | BaS | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| BEER | | comm | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| BENZALDEHYDE | C ₆ H ₅ CHO | nd | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| BENZENE | C ₆ H ₆ | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| - LIGROIN | | 20/80 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| - MONOCHLORINE | C ₆ H ₅ Cl | technically pure | 25 | 3 |
| | | | 60 | |
| | | | 100 | |
| BENZOIC ACID | C ₆ H ₅ COOH | sat | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| BENZYL ALCOHOL | C ₆ H ₅ CH ₂ OH | 100 | 25 | |
| | | | 60 | |
| | | | 100 | |
| BLEACHING LYE | NaOCl+NaCl | 12.50% Cl | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| BORIC ACID | H ₃ BO ₃ | deb | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | sat | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| BRINE | | comm | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| BROMIC ACID | HBrO ₃ | 10 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | 1 |

| Chemical | Formula | Conc. (%) | Temp. (°C) | uPVC |
|-----------------|---|--------------|------------|------|
| BROMINE | Br ₂ | 100 | 25 | 3 |
| - LIQUID | | | 60 | 3 |
| | | | 100 | |
| - VAPOURS | | low | 25 | 2 |
| | | | 60 | |
| | | | 100 | |
| BUTADIENE | C ₄ H ₆ | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| BUTANEDIOL | CH ₃ CH ₂ CHOHCH ₂ OH | 10 | 25 | 1 |
| AQUEOUS | | | 60 | 3 |
| | | | 100 | |
| | | concentrated | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| BUTANE | C ₄ H ₁₀ | 10 | 25 | 1 |
| GAS | | | 60 | |
| | | | 100 | |
| BUTYL | CH ₃ CO ₂ CH ₂ CH ₂ CH ₂ CH ₃ | 100 | 25 | 3 |
| - ACETATE | | | 60 | 3 |
| | | | 100 | |
| - ALCOHOL | C ₄ H ₉ OH | | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| - PHENOL | C ₄ H ₉ C ₆ H ₄ OH | 100 | 25 | 2 |
| | | | 60 | 2 |
| | | | 100 | |
| BUTYLENE GLYCOL | C ₄ H ₆ (OH) ₂ | 100 | 25 | |
| | | | 60 | 2 |
| | | | 100 | |
| BUTYRIC ACID | C ₂ H ₅ CH ₂ COOH | 20 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | concentrated | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| CALCIUM | Ca(HSO ₃) ₂ | nd | 25 | 1 |
| - BISULPHITE | | | 60 | 1 |
| | | | 100 | |
| - CARBONATE | CaCO ₃ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - CHLORATE | CaHCl | nd | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - CHLORIDE | CaCl ₂ | all | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| - HYDROXIDE | Ca(OH) ₂ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - HYPOCHLORITE | Ca(OCl) ₂ | sat | 25 | |
| | | | 60 | 2 |
| | | | 100 | |
| - NITRATE | Ca(NO ₃) ₂ | 50 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - SULPHATE | CaSO ₄ | nd | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - SULPHIDE | CaS | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| CAMPHOR OIL | | nd | 25 | 1 |
| | | | 60 | |
| | | | 100 | |

| Chemical | Formula | Conc. (%) | Temp. (°C) | uPVC |
|--------------------|----------------------------------|--------------------|------------|------|
| CARBON | CO ₂ | | 25 | 1 |
| - DIOXIDE | | | 60 | 2 |
| AQUEOUS SOLUTION | | | 100 | |
| - GAS | | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - DISULPHIDE | CS ₂ | 100 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| - MONOXIDE | CO | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - TETRACHLORIDE | CCl ₄ | 100 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| CARBONIC ACID | H ₂ CO ₃ | sat | 25 | 1 |
| - AQUEOUS SOLUTION | | | 60 | 1 |
| | | | 100 | |
| - DRY | | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - WET | | all | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| CARBON OIL | | comm | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| CHLORAMINE | | dil | 25 | 1 |
| | | | 60 | |
| | | | 100 | |
| CHLORIC ACID | HClO ₃ | 20 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| CHLORINE | Cl ₂ | sat | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| - DRY GAS | | 10 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 100 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| - WET GAS | | 5g/m ³ | 25 | 1 |
| | | | 60 | 3 |
| | | | 100 | |
| | | 10g/m ³ | 25 | 2 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 66g/m ³ | 25 | 2 |
| | | | 60 | 2 |
| | | | 100 | |
| - LIQUID | | 100 | 25 | 3 |
| | | | 60 | |
| | | | 100 | |
| CHLOROACETIC ACID | ClCH ₂ COH | 85 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 100 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| CHLOROBENZENE | C ₆ H ₅ Cl | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| CHLOROFORM | CHCl ₃ | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | 3 |

| Chemical | Formula | Conc. (%) | Temp. (°C) | uPVC |
|----------------------|--|-----------|------------|------|
| CHLOROSULPHONIC ACID | ClHSO ₃ | 100 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| CHROME ALUM | KCr(SO ₄) ₂ | nd | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| CHROMIC ACID | CrO ₃ +H ₂ O | 10 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 30 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | 50 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| CHROMIC SOLUTION | CrO ₃ +H ₂ O+H ₂ SO ₄ | 50/35/15 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| CITRIC ACID | C ₃ H ₄ (OH)(CO ₂ H) ₃ | 50 | 25 | 1 |
| AQ. SOL. min | | | 60 | 1 |
| | | | 100 | |
| COPPER | CuCl ₂ | sat | 25 | 1 |
| - CHLORIDE | | | 60 | 1 |
| | | | 100 | |
| - CYANIDE | CuCN ₂ | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| - FLUORIDE | CuF ₂ | all | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - NITRATE | Cu(NO ₃) ₂ | nd | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| - SULPHATE | CuSO ₄ | dil | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| | | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| COTTONSEED OIL | | comm | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| CRESOL | CH ₃ C ₆ H ₄ OH | £90 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| | | >90 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| CRESYLIC ACID | CH ₃ C ₆ H ₄ COOH | 50 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| CYCLOHEXANE | C ₆ H ₁₂ | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| CYCLOHEXANONE | C ₆ H ₁₀ O | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| DECAHYDRONAFTALENE | C ₁₀ H ₁₈ | nd | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| DEMINEALIZED WATER | | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| DEXTRINE | C ₆ H ₁₂ OCH ₂ O | nd | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |

| Chemical | Formula | Conc. (%) | Temp. (°C) | uPVC |
|-------------------------|------------------------|-----------|------------|------|
| DIBUTYLPHTHALATE | $C_6H_4(CO_2C_4H_9)_2$ | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| DICHLOROACETIC ACID | $Cl_2CHCOOH$ | 100 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| DICHLOROETHANE | CH_2ClCH_2Cl | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| DICHLOROETHYLENE | $ClCH_2Cl$ | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| DIETHYL ETHER | $C_2H_5OC_2H_5$ | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| DIGLYCOLIC ACID | $(CH_2)_2O(CO_2H)_2$ | 18 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| DIMETHYLAMINE | $(CH_3)_2NH$ | 100 | 25 | 2 |
| | | | 60 | 3 |
| | | | 100 | |
| DIOCTYLPHTHALATE | | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| DISTILLED WATER | | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| DRINKING WATER | | 100 | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| ETHERS | | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| ETHYL - ACETATE | $CH_3CO_2C_2H_5$ | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| - ALCOHOL | CH_3CH_2OH | nd | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| - CHLORIDE | CH_3CH_2Cl | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| - ETHER | $CH_3CH_2OCH_2CH_3$ | all | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| ETHYLENE - CHLOROHYDRIN | $ClCH_2CH_2OH$ | 100 | 25 | 3 |
| | | | 60 | 3 |
| | | | 100 | |
| - GLYCOL | $HOCH_2CH_2OH$ | comm | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| FATTY ACIDS | | nd | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| FERRIC - CHLORIDE | $FeCl_3$ | 10 | 25 | 1 |
| | | | 60 | 2 |
| | | | 100 | |
| | | sat | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - NITRATE | $Fe(NO_3)_3$ | nd | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |
| - SULPHATE | $Fe(SO_4)_3$ | nd | 25 | 1 |
| | | | 60 | 1 |
| | | | 100 | |

Class 1: High Resistance Class 2: Limited Resistance Class 3: No Resistance.

Expansion and Contraction

All materials expand and contract with changes in temperature and PVC has a relatively high rate of change.

The coefficient of thermal expansion is $7 \times 10^{-5}/^{\circ}\text{C}$.

A handy rule is 7 mm change in length for every 10 metres for every 10°C change in temperature


Example

A 150 meter line of PVC pipe is being installed with the temperature at 28°C . The service temperature will be 18°C . What allowance has to be made for expansion?

1. Find difference between maximum and minimum temperature, i.e. $28^{\circ}\text{C} - 18^{\circ}\text{C} = 10^{\circ}\text{C}$.
2. Check chart above for expansion per metre. $10^{\circ}\text{C} = 0.7 \text{ mm}$.
3. Multiply answer by total length of line $0.7 \times 150 = 105 \text{ mm}$

This means the pipe will contract approximately 0.1 metres when in service.

Methods of providing for thermal expansion or contraction will depend on the nature of the installation and whether it is above or below ground. (See Installation section).

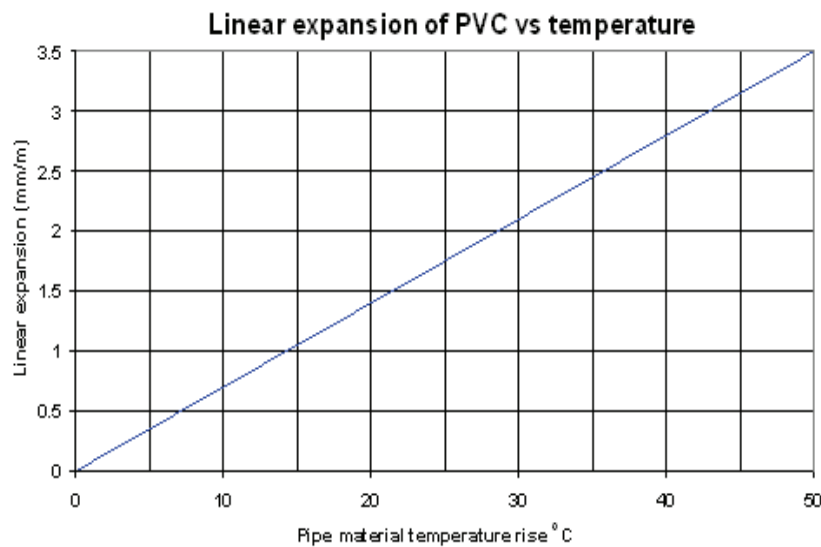

| Length of run 10 meter | |
|----------------------------|--|
| Temp. Change ΔT °C | Thermal Expansion(ΔL) in mm of UPVC |
| 10 | 15 |
| 15 | 17 |
| 20 | 19 |
| 30 | 22 |
| 35 | 25 |
| 40 | 26 |

| Length of run 20 meter | |
|----------------------------|--|
| Temp. Change ΔT °C | Thermal Expansion(ΔL) in mm of UPVC |
| 10 | 32 |
| 15 | 38 |
| 20 | 45 |
| 30 | 51 |
| 35 | 58 |
| 40 | 64 |

| Length of run 15 meter | |
|----------------------------|--|
| Temp. Change ΔT °C | Thermal Expansion(ΔL) in mm of UPVC |
| 10 | 23 |
| 15 | 27 |
| 20 | 32 |
| 30 | 37 |
| 35 | 41 |
| 40 | 46 |

| Length of run 25 meter | |
|----------------------------|--|
| Temp. Change ΔT °C | Thermal Expansion(ΔL) in mm of UPVC |
| 10 | 36 |
| 15 | 44 |
| 20 | 51 |
| 30 | 58 |
| 35 | 66 |
| 40 | 73 |


| Length of run 30 meter | |
|----------------------------|--|
| Temp. Change ΔT °C | Thermal Expansion(ΔL) in mm of UPVC |
| 10 | 46 |
| 15 | 55 |
| 20 | 64 |
| 30 | 73 |
| 35 | 82 |
| 40 | 91 |

SOLVENT WELDING UPVC PIPES AND FITTINGS

The following information are intended to assist Engineers and Contractors to take full advantages of the physical and mechanical properties of uPVC pipes and to achieve the desired results:

A) Method for rubber ring joint installation:

1. Ensure that the mating areas of spigot and socket are thoroughly clean.
2. Setting the rubber ring in groove.
3. Assess the full socket depth by simple measurement and mark spigot accordingly.
4. Apply lubricant to the spigot side and to the inside of the joint on rubber.
5. Accurate axial alignment of the spigot and socket prior to jointing is important, hand feed spigot into rubber joint until resistance from the inner sealing section is felt.
6. Bar and block assembly is recommended because a worker is able feel the amount of force being used and whether the joint goes together smoothly.
7. If undue resistance to pipe insertion is encountered, disassemble the joint and check the position of the rubber ring.

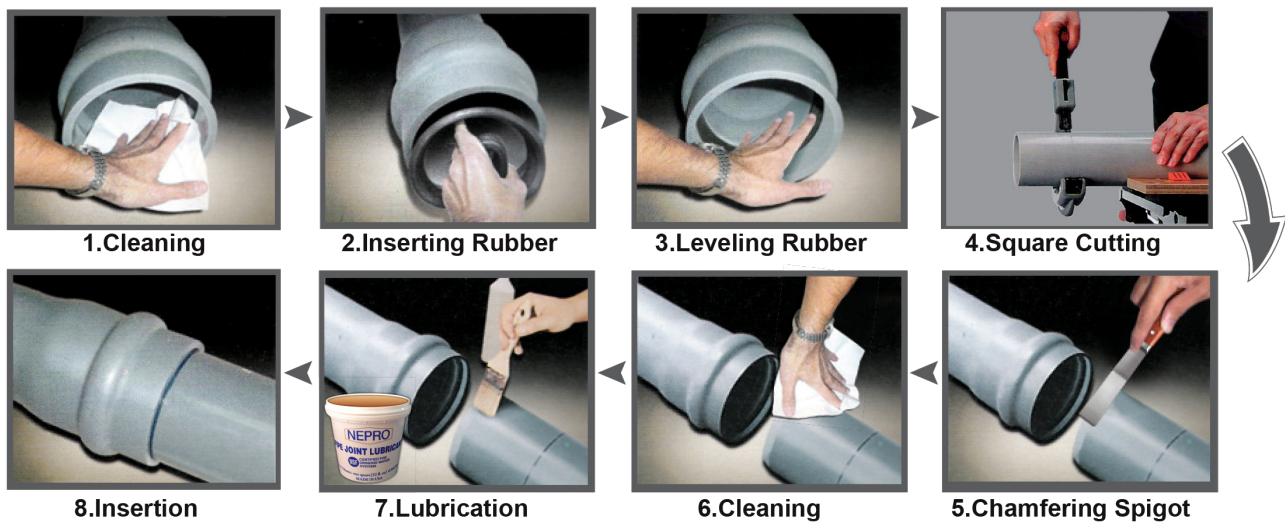

B) Method of solvent welded joint installation:

1. Joint Preparation - Cut Pipe square with the axis, using a fine - tooth saw with a miter box or guide. Remove all burrs and break the sharp lead edges.
2. Cleaning & Priming-Surface to be joined must be cleaned and free of dirt, Moisture, Oil, and other FOREIGN material Applying Weld-On primer.
3. Mark on spigot the full length of the socket side to make sure that the spigot will fit exactly the socket length.
4. Application of solvent cement - PVC solvent cement is fast drying and should be applied as quickly as possible, consistent with good workmanship, Follow up the manufacturer's recommendation to both spigot and socket side with an adequate quantity of cement.
5. Joint Assembly - While both the inside socket surface and the outside surface of the spigot of the pipe are WET with solvent cement, forcefully bottom the spigot in the socket. Turn the pipe or fittings 1/4 turn during assembly (but not after the pipe is bottomed) to distribute the cement evenly.
Hold for a while until handling strength is developed.
Assembly should be completed within 30 seconds after the last application of solvent cement.
6. After Assembly -Wipe excess cement from the pipe at the end of the socket.
Gaps in the cement bead around the pipe perimeter may indicate a defective assembly.
Handle the newly assembled joints carefully after 1 hour.



Importance Points of Pipe Installation with Solvent Cement Joints


1. The joining surfaces must be clean and dry
2. Sufficient cement must be applied to fill the gap between male and female ends
3. The Assembly must be made while the surfaces are still wet and Audi.

4. Completed joints should not be disturbed until they have cured sufficiently to withstand handling.
5. Keep the solvent cement closed and shaded when not actually in use. Discard the solvent cement when a noticeable change in viscosity occurs, when the cement does not flow freely from the brush, or when the cement appears lumpy and stringy.


UPVC PIPES & FITTINGS DIAGRAMS

PIPES


Behaviour of UPVC pipes under long-term stressing

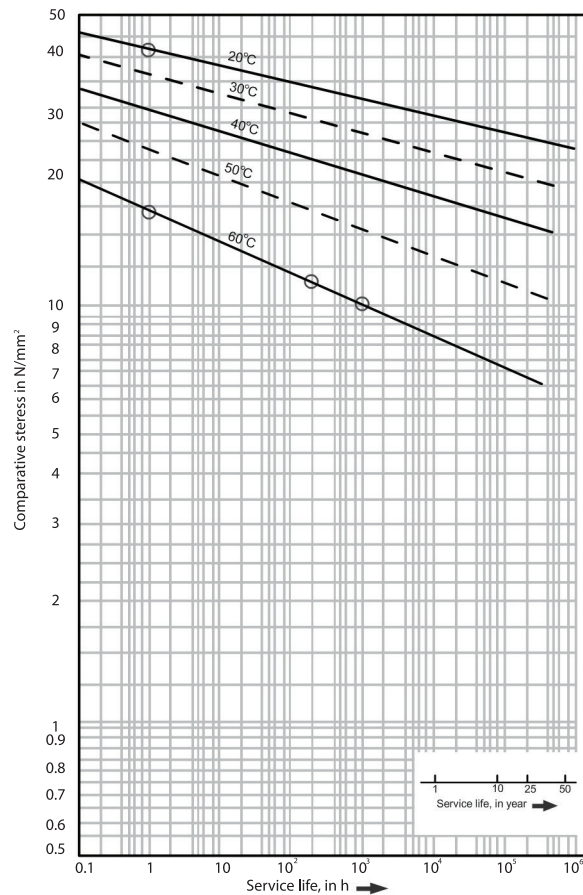

FITTINGS

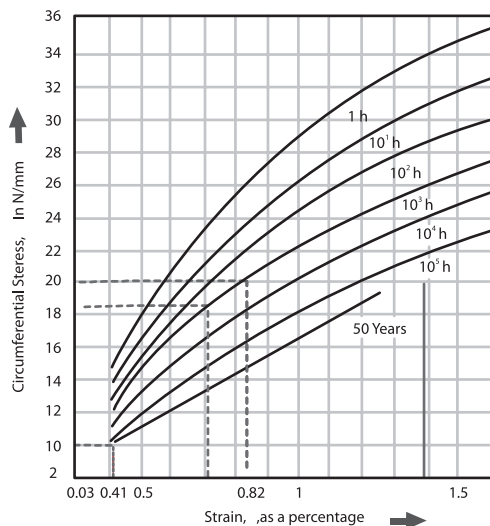

Stress-strain diagram for UPVC at 20°C

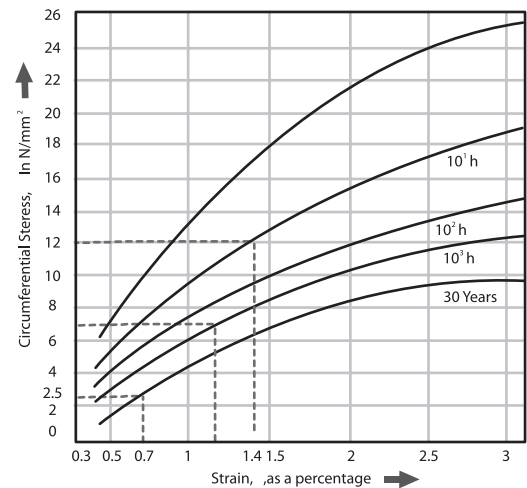

Stress-strain diagram for UPVC at 60°C

When UPVC pressure pipe operates at temperature other than the temperature at which the pipe is rated (20° - OR 23°C) pressure rating should be established on thermal design factors

Standards & Regulations

It is our mission at ABOU GHALY to maintain the highest levels of quality through clear operating-procedures, work instructions, forms and records throughout the company.

Statistical quality control and sound documentation ensures traceability is maintained anytime in the future.

This means that all corporate and plant functions within ABOU GHALY, whether commercial, or operational, are required to be clearly stated and documented, ensuring that the quality of your product is never compromised or been left to chance.

ABOU GHALY Pipes and Fittings are produced according to DIN, BS, ASTM, ISO and Egyptian standards demand, there is also the facility of manufacturing products with special specifications according to customer requirements.

- ABOU GHALY Pipes and fittings are produced with the following standards and regulations:

ES: 1717/2008 pipe and fittings made of unplasticized poly (vinyl chloride) (UPVC) for sewage.

ISO 4065:1996, Thermoplastics pipes (Universal wall thickness table).

ISO 4422 (1:1996, Pipes and fittings made of unplasticized poly (vinyl chloride) (UPVC) for water supply Specifications (Part 1: General).

ES: 848 unplasticized poly (vinyl chloride) (PVC U) PIPES and fittings for water supply

ISO 265 1, Pipes and fittings of plastics materials - Fittings for domestic and industrial waste pipes

-

Basic dimensions: Metric series F Part 1: Unplasticized poly (vinyl chloride) (PVC U).

ISO 3126, Plastics piping systems - Plastics piping components - Measurement and determination of dimensions.

ISO 4633, Rubber seals - joint rings for water supply, drainage and sewerage pipelines - Specification for materials.

EN 580, Plastics piping systems - Unplasticized poly (vinyl chloride) (PVC-U) pipes - Test method for

the resistance to dichloromethane at a specified temperature (DCMT) .

EN 727, Plastics piping and ducting systems - Thermoplastics pipes and fittings - Determination of vicat softening temperature (VST) .

EN 743:1994, Plastics piping and ducting systems Thermoplastics pipes - Determination of the longitudinal reversion.

EN 744, Plastics piping and ducting systems - Thermoplastics pipes - Determination of the longitudinal reversion.

EN 763: 1994 Plastics piping and ducting systems - Injection-moulded thermoplastics fittings - Test method for visually assessing effects of heating.

EN 921, Plastics piping systems - Thermoplastics pipes - Determination of resistance to internal pressure at constant temperature.

EN 1053, Plastics piping systems - Thermoplastics piping systems for non-pressure applications - Test method for water tightness.

EN1411, Plastics piping and ducting systems - Thermoplastics pipes - Determination of resistance to external blows by the staircase method.

EN 1905, Plastics piping systems Unplasticized poly (vinyl chloride) (PVC - U) pipes, fittings and material - Method for assessment of the PVC content based on total chlorine content.

EN 12061, Plastics piping systems - Thermoplastics fittings - Test method for impact resistance.

EN 12256, Plastics piping systems - Thermoplastics fittings - Test method for mechanical strength or flexibility of fabricated fittings.

أهل الخبرة

أبو غالي
abou ghaly
للصناعات البلاستيكية

SDR 26 PSI 160 U.P.V.C PIPE 120 USA STD ASTM D 2241 MEX AGEST 22/09/2011 abou ghaly

www.aboughaly.com

ISO 9001:2008 - OHSAS 18001:2007

تكنولوجيا عالمية بأيدي مصرية
Global Technology With Egyptian Hands


(ABOU GHALY) «JUMPO» «GPF» Products

TECHNICAL DATA OF «JUMPO» (ABOU GHALY) UPVC FITTINGS FOR PLUMBING SYSTEMS (DWV)

According to ASTM - D2466 & D3311 (Sch 40)


ELbow 90°

| Nominal size (inch) | D mm | S mm | H mm | L mm | Type |
|---------------------|-------|------|------|------|------|
| 1/2" | 27 | 2.8 | 16 | 27 | A |
| 3/4" | 33 | 3.2 | 19 | 33 | A |
| 1" | 41 | 3.8 | 22 | 39 | A |
| 1 1/4" | 50 | 3.8 | 26 | 47 | A |
| 1 1/2" | 56 | 3.7 | 31 | 58 | A |
| 2" | 68 | 4.0 | 38 | 70 | A |
| 3" | 100.5 | 5.5 | 48 | 126 | B |
| 3" | 100.5 | 5.5 | 48 | 102 | A |
| 4" | 127 | 6.1 | 51 | 149 | B |
| 4" | 127 | 6.1 | 51 | 120 | A |
| 6" | 183 | 7.5 | 76 | 168 | B |

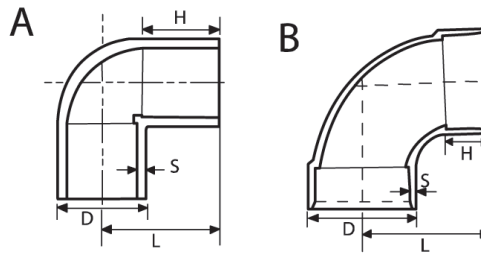


Elbow 90° with access cap

| Nominal size (inch) | D mm | S mm | H mm | L mm | Type |
|---------------------|-------|------|------|------|------|
| 2" | 68 | 4.0 | 38 | 70 | A |
| 3" | 100.5 | 5.5 | 48 | 126 | B |
| 3" | 100.5 | 5.5 | 48 | 102 | A |
| 4" | 127 | 6.1 | 51 | 149 | B |
| 4" | 127 | 6.1 | 51 | 120 | A |
| 6" | 183 | 7.5 | 76 | 168 | A |

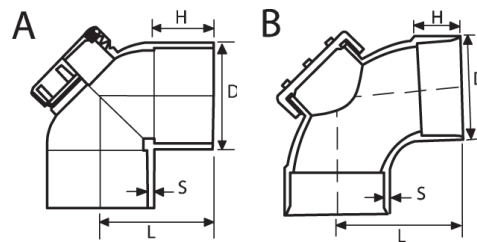


Elbow 45°

| Nominal size (inch) | D mm | S mm | H mm | L mm | Type |
|---------------------|------|------|------|------|------|
| 1/2" | 29 | 3.75 | 22 | 32 | A |
| 3/4" | 35 | 4.1 | 26 | 35 | A |
| 1" | 44 | 5.2 | 29 | 40 | A |
| 1 1/4" | 52 | 3.6 | 31 | 50 | A |
| 1 1/2" | 56 | 3.7 | 31 | 54 | A |
| 2" | 68 | 4 | 38 | 62 | A |
| 3" | 100 | 5.5 | 48 | 100 | B |
| 3" | 100 | 5.5 | 48 | 87 | A |
| 4" | 127 | 6.1 | 51 | 120 | B |
| 4" | 127 | 6.1 | 51 | 103 | A |
| 6" | 183 | 7.5 | 76 | 160 | A |

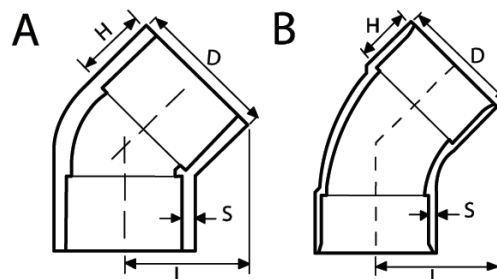


Tee 90°

| Nominal size(inch) | D mm | S mm | H mm | L mm | C mm | Type |
|--------------------|------|------|------|------|------|------|
| 1/2" | 28 | 3.3 | 16 | 27 | 54 | A |
| 3/4" | 35 | 4 | 19 | 33 | 65 | A |
| 1" | 42 | 4.2 | 22 | 39 | 78 | A |
| 1 1/4" | 52 | 4.8 | 31 | 54 | 108 | A |
| 1 1/2" | 56 | 3.7 | 31 | 58 | 116 | A |
| 2" | 68 | 4 | 38 | 70 | 140 | A |
| 3" | 100 | 5.5 | 48 | 126 | 220 | B |
| 3" | 100 | 5.5 | 48 | 102 | 204 | A |
| 4" | 127 | 6.1 | 51 | 149 | 257 | B |
| 4" | 127 | 6.1 | 51 | 119 | 239 | A |
| 6" | 183 | 7.5 | 76 | 168 | 336 | A |

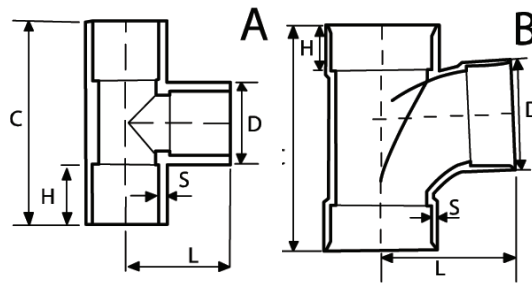


Tee 90 with / cap

| Nominal size(inch) | D mm | S mm | H mm | L mm | C mm | Type |
|--------------------|------|------|------|------|------|------|
| 2" | 68 | 4 | 38 | 70 | 140 | A |
| 3" | 100 | 5.5 | 48 | 126 | 220 | B |
| 3" | 100 | 5.5 | 48 | 102 | 204 | A |
| 4" | 127 | 6.1 | 51 | 149 | 257 | B |
| 4" | 127 | 6.1 | 51 | 119 | 239 | A |
| 6" | 183 | 7.5 | 76 | 168 | 336 | A |

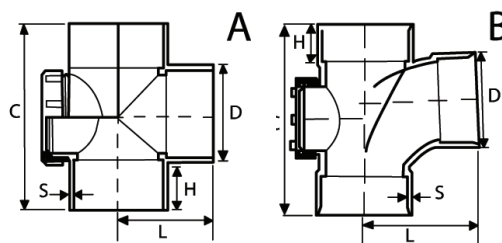


Tee reducer 90°

| Nominal size(inch) | D1 mm | D2 mm | S1 mm | S2 mm | H1 mm | H2 mm | L mm | C mm |
|--------------------|-------|-------|-------|-------|-------|-------|------|-------|
| 3" * 2" | 100 | 70 | 5 | 4.5 | 48 | 38 | 111 | 180 |
| 4" * 2" | 127 | 70 | 6 | 4.5 | 51 | 38 | 122 | 183 |
| 4" * 3" | 127 | 100 | 6 | 5.5 | 51 | 48 | 138 | 222 |
| 6" * 4" | 183 | 126.5 | 7.5 | 6 | 76 | 51 | 168 | 280.5 |




Tee Reducer 90° with / cap

| Nominal size(inch) | D1 mm | D2 mm | S1 mm | S2 mm | H1 mm | H2 mm | L mm | C mm |
|--------------------|-------|-------|-------|-------|-------|-------|------|-------|
| 3" * 2" | 100 | 70 | 5 | 4.5 | 48 | 38 | 111 | 180 |
| 4" * 2" | 127 | 70 | 6 | 4.5 | 51 | 38 | 122 | 183 |
| 4" * 3" | 127 | 100 | 6 | 5.5 | 51 | 48 | 138 | 222 |
| 6" * 4" | 183 | 126.5 | 7.5 | 6 | 76 | 51 | 168 | 280.5 |




Tee 45°

| Nominal size(inch) | D mm | S mm | H mm | C mm | L mm | Type |
|--------------------|-------|------|------|------|------|------|
| 1½" | 56 | 3.7 | 31 | 141 | 91 | A |
| 2" | 69 | 4.5 | 38 | 170 | 110 | A |
| 3" | 100 | 5.5 | 48 | 264 | 161 | B |
| 4" | 127 | 6.1 | 51 | 312 | 195 | B |
| 6" | 181.3 | 6.5 | 76 | 421 | 354 | B |

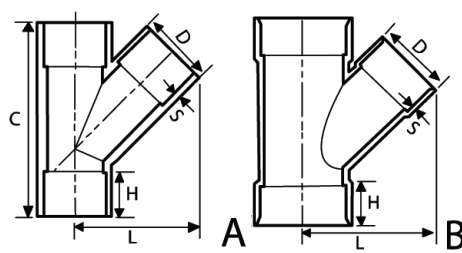


Coupling

| Nominal size(inch) | D mm | S mm | H mm | L mm |
|--------------------|-------|------|------|-------|
| ½" | 27 | 2.8 | 16 | 36 |
| ¾" | 33 | 3.2 | 19 | 41 |
| 1" | 41 | 3.8 | 22 | 48 |
| 1¼" | 50 | 3.8 | 26 | 56 |
| 1½" | 55 | 3.7 | 31 | 65 |
| 2" | 68 | 4.0 | 38 | 80 |
| 3" | 100.5 | 5.5 | 48 | 101 |
| 4" | 127 | 6.1 | 51 | 108 |
| 6" | 183 | 7.1 | 76 | 157.4 |




Syphon

| Nominal size(inch) | D mm | S mm | H mm | L mm | C mm | Type |
|--------------------|------|------|------|------|------|------|
| 4" | 127 | 6.1 | 51 | 230 | 370 | A |
| 4" | 127 | 6.1 | 51 | 215 | 330 | B |

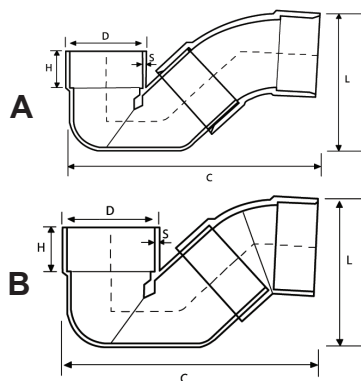


Double branch tee 45°

| Nominal size(inch) | D mm | S mm | H mm | L mm | C mm |
|--------------------|------|------|------|------|------|
| 3" | 100 | 5.5 | 48 | 161 | 264 |
| 4" | 127 | 6.1 | 51 | 195 | 312 |




Double branch tee reducer^{45°}

| Nominal size(inch) | D1 mm | D2 mm | S1 mm | S2 mm | H1 mm | H2 mm | L mm | C mm |
|--------------------|-------|-------|-------|-------|-------|-------|------|------|
| 4" * 2" | 127 | 70 | 6 | 4.5 | 51 | 38 | 150 | 231 |
| 4" * 3" | 127 | 100 | 6 | 5.5 | 51 | 48 | 175 | 270 |




End Cap

| Nominal size(inch) | D mm | S mm | H mm | L mm |
|--------------------|------|------|------|------|
| 1/2" | 29.5 | 3.9 | 16 | 23 |
| 3/4" | 35.5 | 4.5 | 19 | 28 |
| 1" | 44 | 5.3 | 22 | 31 |
| 1 1/4" | 54 | 5.3 | 26 | 34 |
| 1 1/2" | 55 | 4.1 | 31 | 39 |
| 2" | 68 | 5.1 | 38 | 45 |
| 3" | 110 | 5.6 | 48 | 69 |
| 4" | 130 | 7.5 | 61 | 85 |
| 6" | 188 | 8.5 | 86 | 114 |






Repair Coupling

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|------|------|-------|
| 3" | 100 | 5.5 | 101 |
| 4" | 127 | 6.2 | 108 |
| 6" | 183 | 7.1 | 157.1 |




Reducing bush

| Nominal size(inch) | D1 mm | D2 mm | H1 mm | H2 mm | L mm | Type |
|--------------------|-------|-------|-------|-------|------|------|
| 3/4" * 1/2" | 26.7 | 21.5 | 25.5 | 22.5 | 25.5 | A |
| 1" * 1/2" | 33.4 | 21.5 | 30 | 22.5 | 30 | A |
| 1" * 3/4" | 33.4 | 26.85 | 30 | 22.5 | 30 | A |
| 1 1/2" * 1/2" | 48.1 | 21.5 | 31 | 22.5 | 31 | A |
| 1 1/2" * 3/4" | 48.1 | 26.85 | 31 | 22.5 | 31 | A |
| 1 1/2" * 1" | 48.1 | 33.6 | 31 | 30 | 31 | A |
| 2" * 1/2" | 60.3 | 21.5 | 38 | 22.5 | 46 | B |
| 2" * 3/4" | 60.3 | 26.85 | 38 | 22.5 | 46 | B |
| 2" * 1" | 60.3 | 33.6 | 38 | 22 | 46 | B |
| 2" * 1 1/2" | 60.3 | 48.2 | 38 | 31 | 46 | A |
| 3" * 2" | 88.9 | 60.5 | 48 | 38 | 58 | B |
| 4" * 2" | 114.3 | 60.5 | 51 | 38 | 61 | B |
| 4" * 3" | 114.3 | 89.1 | 51 | 48 | 61 | A |
| 6" * 4" | 168.2 | 114.7 | 76 | 51 | 76.2 | B |




Clean Out

| Nominal size(inch) | D mm | S mm | H mm | L mm |
|--------------------|-------|------|------|------|
| 1½" | 48.3 | 3.7 | 31 | 60 |
| 2" | 60.3 | 4.0 | 38 | 69 |
| 3" | 88.9 | 5.5 | 48 | 87 |
| 4" | 114.3 | 6.1 | 51 | 94 |
| 6" | 168.3 | 6 | 76 | 120 |




Tee Reducer. 45°

| Nominal size(inch) | D1 mm | D2 mm | S1 mm | S2 mm | H1 mm | H2 mm | C mm | L mm |
|--------------------|-------|-------|-------|-------|-------|-------|------|------|
| 4" * 2" | 127 | 70 | 6 | 5.2 | 51 | 38 | 231 | 150 |
| 4" * 3" | 127 | 100 | 6 | 5.5 | 51 | 48 | 270 | 175 |
| 6" * 4" | 181.5 | 127 | 6.5 | 6 | 76 | 51 | 351 | 305 |




Double sanitary Tee 87.5°

| Nominal size(inch) | D mm | S mm | H mm | C mm | L mm |
|--------------------|------|------|------|------|------|
| 3" | 100 | 5.5 | 48 | 220 | 126 |
| 4" | 127 | 6.1 | 51 | 257 | 149 |




Air vent

| Nominal size(inch) | D mm | H mm | L mm |
|--------------------|------|------|------|
| 3" | 100 | 48 | 88 |
| 4" | 123 | 51 | 100 |




Extension Sockets

| Nominal size(inch) | D mm | d mm | d1 mm | S mm | H mm | L mm |
|--------------------|------|-------|-------|------|------|------|
| 110 mm | 122 | 114.5 | 119 | 6 | 8 | 100 |
| 125 mm | 140 | 127 | 132 | 6.7 | 8 | 100 |
| 125 mm | 140 | 127 | 132 | 6.7 | 8 | 150 |





Elbow 90° SJXF.th

| Nominal size(inch) | D mm | S mm | H mm | L mm |
|--------------------|-------|------|------|------|
| 1½" * 1½" | 56 | 3.5 | 31 | 58 |
| 1½" * 1¼" | 56-50 | 3.5 | 31 | 58 |




Floor Trap

| Nominal size(inch) | D mm | H1 mm | H2 mm | A mm | S mm | L mm | Type |
|--------------------|------|-------|-------|---------|------|------|------|
| outlet 3" | 96.5 | 48 | | 125 | 4.2 | 99 | A |
| inlet 1½" | 56.5 | | 31 | | | | |
| outlet 3" | 96.5 | 48 | | 125 | 4.2 | 99 | A |
| inlet 2" | 68.8 | | 38 | | | | |
| outlet 2" | 68.8 | 38 | | 125/110 | 4.2 | 99 | A |
| inlet 1½" | 56.5 | | 31 | | | | |
| outlet 2" | 68.8 | 38 | | 125/110 | 4.2 | 99 | A |
| inlet 2" | 68.8 | | 38 | | | | |
| outlet 2" | 69.8 | 27.0 | | 110 | 4.8 | 70 | B |
| inlet 1½" | 58.8 | | 30.2 | | | | |
| Outlet 1½" | 61.6 | 34 | | 110 | 5.5 | 70 | B |
| inlet 1½" | 58.8 | | 30.2 | | | | |




Elbow 45°

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|------|------|------|
| 20 mm | 29 | 4.4 | 22 |
| 25 mm | 35 | 4.9 | 26 |
| 32 mm | 44 | 5.8 | 29 |
| 40 mm | 52 | 5.8 | 26 |
| 50 mm | 60.5 | 5.2 | 32 |
| 63 mm | 73.5 | 5.2 | 38 |
| 75 mm | 84.5 | 4.5 | 45 |
| 90 mm | 100 | 5.2 | 48 |
| 110 mm | 122 | 6 | 52 |
| 160 mm | 172 | 6 | 70 |




Elbow 87.5°

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|-------|------|------|
| 20 mm | 27 | 3.4 | 16 |
| 25 mm | 33 | 3.9 | 19 |
| 32 mm | 41 | 4.5 | 22 |
| 40 mm | 50 | 5 | 26 |
| 50 mm | 58 | 4 | 32 |
| 63 mm | 71 | 4 | 38 |
| 75 mm | 84.5 | 4.5 | 45 |
| 90 mm | 100 | 5.2 | 48 |
| 110 mm | 122.5 | 6 | 52 |
| 160 mm | 172.5 | 6 | 70 |




Elbow 87.5° with access cap

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|-------|------|------|
| 63 mm | 70 | 3.5 | 38 |
| 75 mm | 84.5 | 4.5 | 45 |
| 90 mm | 100 | 5.2 | 48 |
| 110 mm | 122.5 | 6 | 52 |
| 160 mm | 172.5 | 6 | 70 |




Tee 87.5°

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|-------|------|------|
| 20 mm | 27 | 3.4 | 16 |
| 25 mm | 33 | 3.9 | 19 |
| 32 mm | 43 | 5.5 | 22 |
| 40 mm | 50 | 5.9 | 31 |
| 50 mm | 57 | 3.5 | 32 |
| 63 mm | 70 | 3.5 | 38 |
| 75 mm | 84.5 | 4.7 | 45 |
| 90 mm | 100 | 5 | 48 |
| 110 mm | 122.5 | 6 | 52 |
| 160 mm | 172.5 | 6 | 70 |




Tee 87.5° with cap

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|------|------|------|
| 50 mm | 57 | 3.5 | 32 |
| 63 mm | 70 | 3.5 | 38 |
| 75 mm | 84.5 | 4.7 | 45 |
| 90 mm | 100 | 5 | 48 |
| 110 mm | 122 | 6 | 52 |
| 160 mm | 172 | 6 | 70 |




Tee 45°

| Nominal size(inch) | D mm | S mm | H mm | L mm |
|--------------------|-------|------|------|------|
| 50 mm | 57.5 | 3.6 | 32 | A |
| 63 mm | 71 | 3.7 | 38 | A |
| 75 mm | 84.5 | 4.7 | 45 | B |
| 90 mm | 100 | 5 | 48 | B |
| 110 mm | 122.5 | 6 | 51 | B |
| 160 mm | 174 | 7 | 75 | A |



A




B




Tee Reducer 87.5°

| Nominal size(inch) | D1 mm | D2 mm | S1 mm | S2 mm | H1 mm | H2 mm |
|--------------------|-------|-------|-------|-------|-------|-------|
| 110/50 mm | 122 | 57 | 6 | 3.5 | 52 | 39 |
| 110/63 mm | 122 | 70 | 6 | 3.5 | 52 | 38 |
| 110/75 mm | 122 | 85 | 6 | 4.7 | 52 | 45 |
| 160/110mm | 172 | 122 | 6 | 6 | 70 | 52 |
| 75/2" mm | 85 | 67.5 | 4.5 | 3.5 | 45 | 38 |
| 110/2" mm | 122 | 67.5 | 6 | 3.5 | 52 | 38 |




Tee Red. 87.5° with cap

| Nominal size(inch) | D1 mm | D2 mm | S1 mm | S2 mm | H1 mm | H2 mm |
|--------------------|-------|-------|-------|-------|-------|-------|
| 110/50 mm | 122 | 57 | 6 | 3.5 | 52 | 39 |
| 110/63 mm | 122 | 70 | 6 | 3.5 | 52 | 38 |
| 110/75 mm | 122 | 85 | 6 | 4.7 | 52 | 45 |
| 160/110mm | 172 | 122 | 6 | 6 | 70 | 52 |
| 75/2" mm | 85 | 67.5 | 4.5 | 3.5 | 45 | 38 |
| 110/2" mm | 122 | 67.5 | 6 | 3.5 | 52 | 38 |




Tee Reducer 45°

| Nominal size (inch) | D1 mm | D2 mm | S1 mm | S2 mm | H1 mm | H2 mm |
|---------------------|-------|-------|-------|-------|-------|-------|
| 110/50 mm | 122 | 57 | 6 | 3.5 | 52 | 32 |
| 110/63 mm | 122 | 70 | 6 | 3.5 | 52 | 38 |
| 110/75 mm | 122 | 85 | 6 | 5 | 52 | 45 |
| 160/110mm | 174 | 122 | 7 | 6 | 75 | 52 |
| 110/2" mm | 122 | 67 | 6 | 3.5 | 52 | 38 |




Double branch tee 45°

| Nominal size (inch) | D mm | S mm | H mm |
|---------------------|------|------|------|
| 90 mm | 100 | 5 | 48 |
| 110 mm | 122 | 6 | 52 |




Coupling

| Nominal size (inch) | D mm | S mm | H mm |
|---------------------|-------|------|------|
| 20 mm | 27 | 3.4 | 16 |
| 25 mm | 33 | 3.9 | 19 |
| 32 mm | 41 | 4.5 | 22 |
| 40 mm | 50 | 5 | 26 |
| 50 mm | 57 | 3.5 | 32 |
| 63 mm | 70 | 3.5 | 39 |
| 75 mm | 84 | 4.5 | 45 |
| 110 mm | 122.5 | 6 | 52 |
| 160 mm | 172.5 | 6 | 70 |




End Cap

| Nominal size (inch) | D mm | S mm | H mm |
|---------------------|------|------|------|
| 20 mm | 29.5 | 3.4 | 16 |
| 25 mm | 35.5 | 3.9 | 19 |
| 32 mm | 44 | 4.5 | 22 |
| 40 mm | 54 | 3.5 | 26 |
| 50 mm | 57 | 3.5 | 32 |
| 63 mm | 71 | 3.5 | 38 |
| 75 mm | 90 | 5 | 44 |
| 110 mm | 125 | 6 | 61 |
| 160 mm | 188 | 7 | 86 |





Clean Out

| Nominal size(mm) | D mm | S mm | H mm |
|------------------|------|------|------|
| 50mm | 50 | 3.7 | 35 |
| 63mm | 63 | 4.0 | 40 |
| 75mm | 75 | 5 | 44 |
| 90mm | 90 | 5 | 52 |
| 110mm | 110 | 5 | 53 |
| 160mm | 160 | 6 | 79 |




Double branch tee 90°

| Nominal size(inch) | D mm | S mm | H mm | Type |
|--------------------|------|------|------|------|
| 75 mm | 84 | 4.5 | 45 | A |
| 90 mm | 100 | 5.2 | 48 | B |
| 110 mm | 121 | 5.3 | 51 | A |





Double branch Reducer. 45°

| Nominal size(inch) | D1 mm | D2 mm | S1 mm | S2 mm | H1 mm | H2 mm |
|--------------------|-------|-------|-------|-------|-------|-------|
| 110/75 mm | 122 | 85 | 6 | 5 | 52 | 45 |
| 110/2" mm | 122 | 67.5 | 6 | 3.5 | 52 | 38 |




Female Thread Adaptor

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|------|------|------|
| 1½" * 1½" | 56 | 3 | 32 |




Syphon

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|------|------|------|
| 4mm | 122 | 6 | 52 |

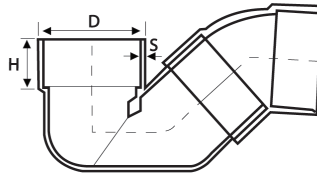



Air vent

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|------|------|------|
| 75mm | 82 | 3 | 40 |
| 110mm | 118 | 4 | 50 |




Reducing bush

| Nominal | D1 mm | D2 mm | H1 mm | H2 mm | Type |
|-------------|-------|-------|-------|-------|------|
| 25 - 20mm | 25 | 20.2 | 25.5 | 22.5 | A |
| 32 - 20mm | 32 | 20.2 | 30 | 22.5 | A |
| 32 - 25mm | 32 | 25.2 | 30 | 25.5 | A |
| 40 - 20mm | 40 | 20.2 | 26 | 16 | A |
| 40 - 25mm | 40 | 25.2 | 26 | 19 | A |
| 40 - 32mm | 40 | 32.2 | 26 | 22 | A |
| 50 - 32mm | 50 | 32.2 | 32 | 22 | A |
| 50 - 40mm | 50 | 40.2 | 32 | 26 | A |
| 63 - 40mm | 63 | 40.2 | 38 | 26 | A |
| 63 - 50mm | 63 | 50.2 | 38 | 31 | A |
| 75 - 50mm | 75 | 50.2 | 44 | 31 | A |
| 75 - 63mm | 75 | 63.2 | 44 | 38 | A |
| 90 - 50mm | 90 | 50.2 | 48 | 32 | B |
| 90 - 63mm | 90 | 63.2 | 48 | 38 | B |
| 90 - 75mm | 90 | 75.2 | 51 | 48 | B |
| 110 - 50mm | 110 | 50.2 | 52 | 38 | B |
| 110 - 63mm | 110 | 63.2 | 52 | 38 | B |
| 110 - 75mm | 110 | 75.2 | 52 | 45 | B |
| 110 - 90mm | 110 | 90.2 | 52 | 48 | B |
| 160 - 110mm | 160 | 110.3 | 70 | 52 | B |
| 110 - 2" | 110 | 60.2 | 52 | 38 | B |
| 75 - 2" | 75 | 60.2 | 47 | 38 | A |
| 2" - 50mm | 60 | 50.2 | 38 | 32 | A |

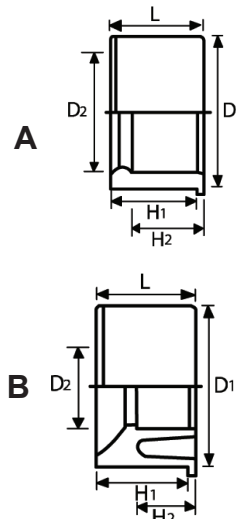


Elbow 90° SJXF.th

| Nominal size(inch) | D mm | S mm | H mm |
|--------------------|------|------|------|
| 50 * 1¼" | 55 | 3 | 32 |
| 50 * 1½" | 65 | 3 | 32 |




Extension Sockets

| Nominal size(inch) | D mm | d mm | d1 mm | S mm | H mm | L mm |
|--------------------|------|-------|-------|------|------|------|
| 110 mm | 122 | 114.5 | 119 | 6 | 8 | 150 |
| 125 mm | 139 | 127 | 132 | 6.7 | 8 | 100 |
| 125 mm | 139 | 127 | 132 | 6.7 | 8 | 150 |




Floor Trap

| Nominal size(mm) | D mm | S mm | H mm | L mm |
|------------------|-------|------|------|-------|
| 110mm | 109.5 | 3.5 | 7 | 147.5 |
| 125mm | 124.5 | 3.5 | 7 | 147.5 |

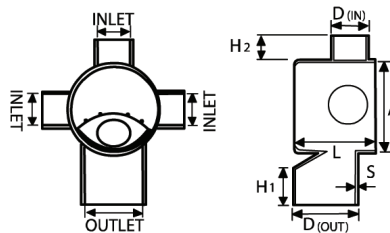

Repair Coupling

| Nominal size(mm) | D mm | S mm | H mm |
|------------------|------|------|------|
| 75mm | 84 | 4.5 | 94 |
| 110mm | 122 | 5.5 | 109 |



TECHNICAL DATA OF (ABOU GHALY) «JUMPO» «GPF» UPVC PIPES FOR PLUMBING SYSTEMS (DWV)

According to ASTM D 2241 (SDR) Series

| Nominal Size (inch) | Wall Thickness | | | | | | | |
|------------------------|-------------------|------------------------|----------------------|----------------------|----------------------|-----------------------|---------------------|---------------------|
| | Outside (D) mm | SDR 13.5 (21.7 Bar) | SDR 17 (17.8 Bar) | SDR 21 (13.8 Bar) | SDR 26 (11.0 Bar) | SDR 32.5 (8.6 Bar) | SDR 41 (6.9 Bar) | SDR 64 (4.3 Bar) |
| 1/2" | 21.34 | 1.9 | | ----- | ----- | ----- | ----- | ----- |
| 3/4" | 26.67 | 2.0 | 1.6 | 1.52 | ----- | ----- | ----- | ----- |
| 1" | 33.40 | 2.5 | 2.0 | 1.60 | 1.52 | ----- | ----- | ----- |
| 1 1/4" | 42.16 | 3.1 | 2.5 | 2.01 | 1.63 | 1.52 | ----- | ----- |
| 1 1/2" | 48.26 | 3.6 | 2.9 | 2.29 | 1.85 | 1.52 | ----- | ----- |
| 2" | 60.32 | 4.5 | 3.6 | 2.87 | 2.31 | 1.58 | ----- | ----- |
| 3" | 88.90 | 6.6 | 5.2 | 4.24 | 3.43 | 2.74 | 2.16 | ----- |
| 4" | 114.30 | 5.8 | 6.7 | 5.44 | 4.39 | 3.51 | 2.79 | 1.78 |
| 6" | 168.28 | 12.5 | 9.9 | 8.03 | 6.48 | 5.18 | 4.11 | 2.64 |
| 8" | 219.08 | ----- | 12.9 | 10.41 | 8.43 | 6.73 | 5.33 | 3.43 |

METRIC UPVC PIPES FOR PLUMBING SYSTEM (DWV)

| Outside Dia (mm) | Thickness (mm) | Weight Kg/M |
|---------------------|-------------------|----------------|
| 32 | 1.5 | 0.240 |
| 32 | 1.8 | 0.285 |
| 32 | 2.4 | 0.370 |
| 40 | 1.8 | 0.395 |
| 40 | 1.9 | 0.415 |
| 48 | 2.5 | 0.550 |
| 48 | 3.7 | 0.821 |
| 50 | 1.8 | 0.422 |
| 50 | 2.4 | 0.546 |
| 60 | 2.7 | 0.785 |
| 60 | 3.9 | 1.011 |
| 63 | 1.9 | 0.568 |
| 63 | 3 | 0.842 |
| 75 | 1.8 | 0.680 |
| 75 | 2.2 | 0.830 |
| 75 | 3 | 1.122 |
| 75 | 4 | 1.311 |
| 75 | 5 | 1.788 |
| 110 | 2.2 | 1.220 |
| 110 | 3 | 1.635 |
| 110 | 3.2 | 1.744 |
| 110 | 4 | 2.122 |
| 110 | 5 | 2.632 |
| 110 | 6 | 3.200 |
| 110 | 7 | 3.620 |
| 160 | 3.2 | 2.410 |
| 160 | 4.7 | 3.005 |
| 160 | 4 | 3.310 |
| 160 | 5 | 3.763 |
| 160 | 7 | 5.431 |

According to ASTM D 1785(SCH 40 / 80)

| Nominal outside diameter inch | Outside Diameter mm | | SCH40 | | | | SCH80 | | | |
|----------------------------------|------------------------|-------|--------------|-----|-----------------|-----------------------------|--------------|------|-----------------|-----------------------------|
| | | | Thickness mm | | Weight Kg/mt | Pressure rating (bar) | Thickness mm | | Weight Kg/mt | Pressure rating (bar) |
| | MIN | MAX | MIN | MAX | | | MIN | MAX | | |
| ½" | 21.2 | 21.2 | 2.8 | 3.3 | 0.24 | 41.4 | 3.7 | 4.2 | 0.31 | 58.6 |
| ¾" | 26.6 | 26.9 | 2.9 | 3.4 | 0.33 | 33.1 | 3.9 | 4.4 | 0.41 | 47.6 |
| 1" | 33.4 | 33.7 | 3.4 | 3.9 | 0.48 | 31.0 | 4.6 | 5.1 | 0.60 | 43.4 |
| 1¼" | 42.1 | 42.4 | 3.6 | 4.1 | 0.65 | 25.5 | 4.9 | 5.4 | 0.48 | 35.9 |
| 1½" | 48.1 | 48.4 | 3.7 | 4.2 | 0.77 | 22.8 | 5.1 | 5.7 | 1.03 | 32.4 |
| 2" | 60.2 | 60.5 | 3.9 | 4.4 | 1.04 | 19.3 | 5.5 | 6.2 | 1.41 | 27.6 |
| 3" | 88.7 | 89.1 | 5.5 | 6.2 | 2.14 | 17.9 | 7.6 | 8.5 | 2.88 | 25.5 |
| 4" | 114.1 | 114.5 | 6.0 | 6.7 | 3.05 | 15.2 | 8.6 | 9.6 | 4.22 | 22.1 |
| 6" | 168 | 168.5 | 7.1 | 8.0 | 5.37 | 12.4 | 11.0 | 12.3 | 8.05 | 19.3 |
| 8" | 218.8 | 219.4 | 8.2 | 9.2 | 8.11 | 11.0 | 12.7 | 14.2 | 12.23 | 17.2 |

Pipes with three layers

| Nominal Size (inch) | Wall Thickness | | | | | |
|------------------------|-------------------|----------------------|----------------------|-----------------------|---------------------|---------------------|
| | Outside (D) mm | SDR 21 (13.8 Bar) | SDR 26 (11.0 Bar) | SDR 32.5 (8.6 Bar) | SDR 41 (6.9 Bar) | SDR 64 (4.3 Bar) |
| 1½" | 48.26 | 2.29 | 1.85 | 1.52 | ---- | ---- |
| 2" | 60.32 | 2.87 | 2.31 | 1.58 | ---- | ---- |
| 3" | 88.90 | 4.24 | 3.43 | 2.74 | 2.16 | ---- |
| 4" | 114.30 | 5.44 | 4.39 | 3.51 | 2.79 | 1.78 |
| 6" | 168.28 | 8.03 | 6.48 | 5.18 | 4.11 | 2.64 |
| 8" | 219.08 | 10.41 | 8.43 | 6.73 | 5.33 | 3.43 |



UPVC PIPES FOR WATER SUPPLY AND IRRIGATION, ACCORDING TO EGYPTIAN STANDARDE.S 2008/1-848 – ISO 1996/2-4422

| Normal outside diameter mm | 6bar | | 8bar | | 10 bar | | 12.5 bar | | 16 bar | | 25 bar | |
|----------------------------|----------------------------|-------------|--------------------------|-------------|-------------------------|-------------|--------------------------|-------------|----------------------------|-------------|-----------------------|-------------|
| | S 16.7 SDR 34.4 PN 6 | | S 12.5 SDR 26 PN 8 | | S 10 SDR 21 PN 10 | | S 8 SDR 17 PN 12.5 | | S 6.3 SDR 13.6 PN 16 | | S 4 SDR 9 PN 25 | |
| | Wall Thickness mm | weight kg/m | Wall Thickness mm | No. wt kg/m | Wall Thickness mm | weight kg/m | Wall Thickness mm | weight kg/m | Wall Thickness mm | weight kg/m | Wall Thickness mm | weight kg/m |
| 20 | | | | | | | | | 1.5 | 0.137 | 3.2 | 0.196 |
| 25 | | | | | | | 1.5 | 0.170 | 1.9 | 0.212 | 2.8 | 0.294 |
| 32 | | | | | 1.6 | 0.264 | 1.9 | 0.277 | 2.4 | 0.342 | 3.6 | 0.482 |
| 40 | | | 1.6 | 0.291 | 1.9 | 0.350 | 2.4 | 0.437 | 3.0 | 0.525 | 4.5 | 0.750 |
| 50 | | | 2.0 | 0.422 | 2.4 | 0.552 | 3.0 | 0.683 | 3.7 | 0.809 | 5.6 | 1.16 |
| 63 | 1.9 | 0.562 | 2.5 | 0.717 | 3.0 | 0.854 | 3.8 | 1.09 | 4.7 | 1.29 | 7.1 | 2.04 |
| 75 | 2.2 | 0.782 | 2.9 | 0.990 | 3.6 | 1.22 | 4.5 | 1.54 | 5.6 | 1.82 | 8.4 | 2.60 |
| 90 | 2.7 | 1.13 | 3.5 | 1.43 | 4.3 | 1.75 | 5.4 | 2.21 | 6.7 | 2.61 | 10.1 | 4.14 |

UPVC PIPES FOR WATER SUPPLY AND IRRIGATION, ACCORDING TO EGYPTIAN STANDARDE.S 2008/1-848 – ISO 1996/2-4422


| Normal outside diameter mm | 8 bar | | 12.5 bar | | 20 bar | | 25 bar | |
|----------------------------|------------------------|-------------|---------------------------|-------------|----------------------------|-------------|------------------------|-------------|
| | S 16 SDR 33 PN 8 | | S 10 SDR 21 PN 12.5 | | S 6.3 SDR 13.6 PN 20 | | S 5 SDR 11 PN 25 | |
| | Wall Thickness mm | weight kg/m | Wall Thickness mm | No. wt kg/m | Wall Thickness mm | weight kg/m | Wall Thickness mm | weight kg/m |
| 110 | 3.4 | 1.70 | 5.3 | 2.61 | 8.1 | 3.90 | 10 | 5.00 |
| 125 | 3.9 | 2.21 | 6 | 3.34 | 9.2 | 5.01 | 11.4 | 6.48 |
| 140 | 4.3 | 2.74 | 6.7 | 4.18 | 10.3 | 6.27 | 12.7 | 8.09 |
| 160 | 4.9 | 3.57 | 7.7 | 5.47 | 11.8 | 8.17 | 14.6 | 10.63 |
| 180 | 5.5 | 4.51 | 8.6 | 6.88 | 13.3 | 10.4 | 16.4 | 13.40 |
| 200 | 6.2 | 5.64 | 9.6 | 8.51 | 14.7 | 12.63 | 18.2 | 16.57 |
| 225 | 6.9 | 7.06 | 10.8 | 10.8 | 16.6 | 16.1 | | |
| 250 | 7.7 | 8.76 | 11.9 | 13.2 | 18.4 | 19.9 | | |
| 280 | 8.6 | 10.96 | 13.4 | 16.6 | 20.6 | 24.9 | | |
| 315 | 9.7 | 13.91 | 15 | 20.9 | 23.2 | 31.5 | | |
| 355 | 10.9 | 17.62 | 16.9 | 26.5 | 26.1 | 39.9 | | |
| 400 | 12.3 | 22.40 | 19.1 | 33.7 | 29.4 | 50.8 | | |

TRANSPORT, HANDLING & STORAGE

Un plasticized PVC pipes are strong but light, its specific gravity being approximately one-fifth that of cast iron. As a result, these pipes are more easily handled than their metal counterparts. Reasonable care, however, should be exercised at all times, and when offloading, pipes should be lowered, not dropped to the ground.

Pipe should be given adequate support at all times. Pipes should not be stacked in large piles especially in warm temperature conditions, as the lower layers may distort: resulting in difficulties when joining and for pipe alignment. Any pipe with ends prepared for joining (socket and spigot joints, RR joints, etc.) should be stacked in layers with the socket, placed at alternate ends of the stack and with sockets protruding to avoid lop-sided stacks and the Imparting of permanent set to pipes.

Particularly in the case of Ring pipe, rubber rings should not be exposed to solar radiation for any length of time if they are not coated. It is recommended to stock them in a cool and shady place. Rubber rings should not come in touch with chemicals, grease, oil and to be stored for too long a time.

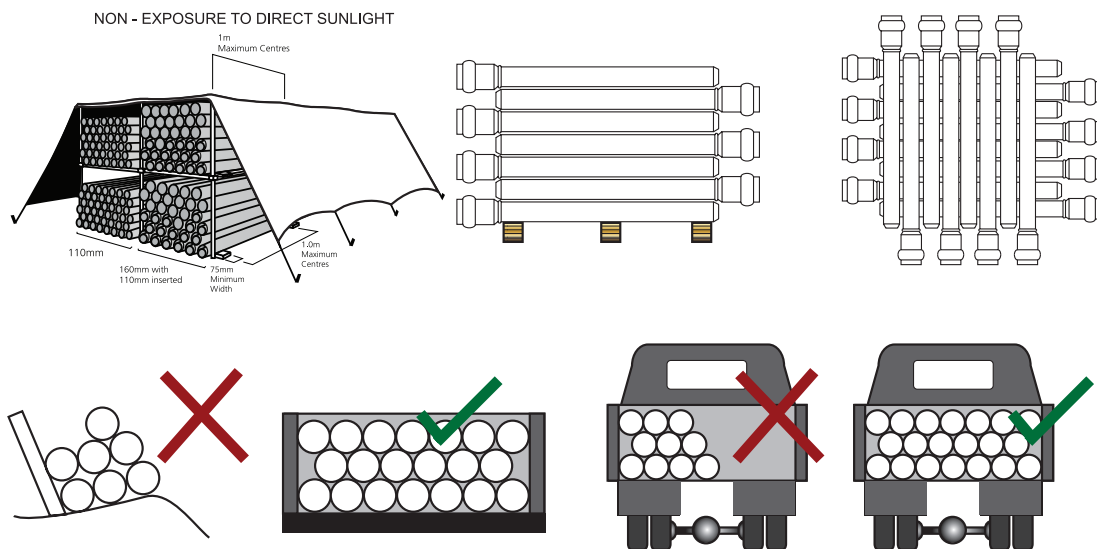

For long-term storage, pipe racks should provide continuous support, but if this is not possible, timber of at least 75 mm bearing width at spacing not greater than 1 m centers for pipe sizes 150 mm and above, should be placed beneath the pipes and at 2 m centers at the side, if the stacks are rectangular. These spacing apply to pipe size 160 mm and above. Closer supports will be required for sizes below 160 mm. In such pipe racks, pipes may be stored not more than seven layers or 1.5 m high, whichever is the lesser, but if different classes of pipe are kept in the same racks, then the thickest classes must always be at the bottom.

For temporary storage in the field, where racks are not provided, the ground should be level and free from coarse stones. Pipes stored thus should not exceed three layers high and should be staked to prevent movement.

Stack heights should be reduced if pipes are nested, i. e. pipes stored inside pipes of larger diameters. Reductions in height should be proportional to the weight of the nested pipe compared to the weight of the pipes normally contained in such stowage's.

Since the soundness of any joint depends on the condition of the spigot and the socket, special care must be taken in transit, handling and storage to avoid damage to the ends.

When loading pipes on the vehicles, care must be taken to avoid their coming into contact with any sharp corners such as cope irons, loose nail-heads, etc., as pipes may be damaged by being rubbed against these during transit whilst in transit pipes shall be well secured over their entire length and not allowed to project unsecured over the tailboard of the lorry. Pipes may be off loaded from lorries and or by rolling them gently down timbers, care being taken to ensure that pipes do not fall one upon

another nor on any hard or uneven surfaces. Fork-lift trucks will have to be used for bundles and large unit loads.

DEFLECTION


The ring integral socket permits an angular deflection at the joint of 2 to 3 degree the introduction of joint deflection is however, generally unnecessary in an inherently flexible uPVC pipeline.

Sufficient flexibility is provided by individual pipe lengths to enable gentle curves to be negotiated without imparting deflection at the joints.

As a general guide the cold bending radius R of a uPVC pipe length can be calculated as follows"

$$R = 300 \times \text{External Diameter}$$

Where a shorter radius of curvature is required, then uPVC formed bends must be introduced.

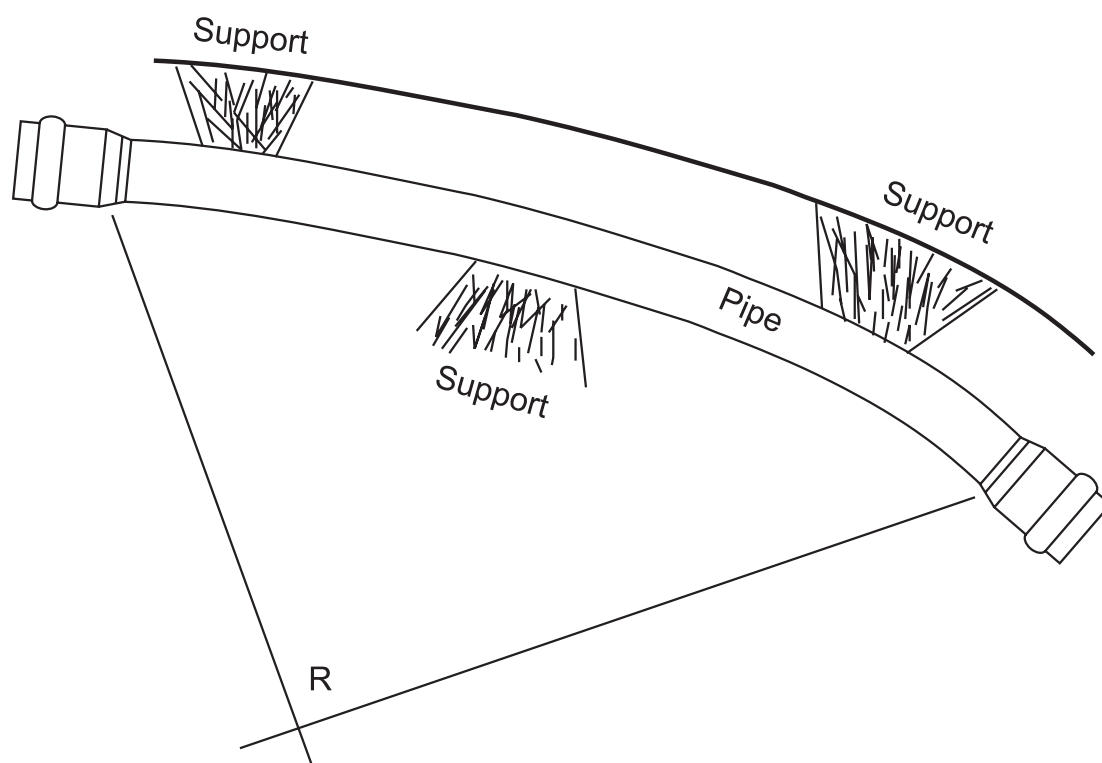

aboughaly
for plastic industries

أبوغالي
about ghaly
للصناعات البلاستيكية



Long life guarantee



U.P.V.C PIPES & FITTINGS

     /aboughalyco
www.aboughaly.com




iso 9001:2008 - OHSAS 18001:2007



تكنولوجيا عالمية بأيدي مصرية
Global Technology With Egyptian Hands





Certificates

BUREAU VERITAS
Certification



JUMBO FOR PLASTIC INDUSTRIES

Address: New EL-Salhia City-Industrial zone1 –sector E - #10
ARAB REPUBLIC OF EGYPT

*Bureau Veritas Certification Holding SAS – UK Branch certifies that the Management System
Of the above organisation has been audited and found to be in accordance with the
Requirements of the management system standards detailed below*

ISO 9001:2015

Scope of certification


MANUFACTURING OF PVC PLASTIC PIPES AND FITTINGS

Original cycle start date: 8th June 2015
Expiry date of previous cycle: 7th June 2018
Recertification Audit date: 7th May 2018
Certification / Recertification cycle start date: 7th June 2018

Subject to the continued satisfactory operation of the organization's Management System,
This certificate expires on: 7th June 2021

Certificate No. IND18.9208 U/Q **Version: No.1**

Revision date: 7-JUN-2018


Signed on Behalf of BVCH UK Branch
Ayman Ibrahim
Certification BL. Manager



0008

Certification body address: 66, Prescott Street, London, E1 8HG, United Kingdom
Local office: 51 Hassan Aflaton Street, Ard El Golf, Nasr City, P.O. Box 1731, Cairo, Arab Republic of Egypt
Further clarifications regarding the scope of this certificate and the applicability of the management system
Requirements may be obtained by consulting the organisation. To check this certificate validity,
Please call: (+202 2418 3020)

Page 1 of 1



تقرير الاختبارات

| | |
|------------------------------|---|
| رقم التقرير | MOI 8156 08 2017 |
| اسم الشركة أو العميل | شركة جامبو للصناعات البلاستيكية (أبو غالي) |
| تاريخ الطلب | ٢٠١٧ / ٨ / ٢١ |
| المنتج المطلوب إختباره | مطلب إجراء الاختبارات اللازمة على عينة كوع UPVC قطر ١٠٠ مم ذات لون أبيض. |
| المواصفات المستخدمة | طبقا للمواصفة الأمريكية D2665, D2241, ASTM D1784. |
| النتائج | جميع نتائج الاختبارات مدونة وميالة بالتفصيل في صفحات التقرير (عدد صفحات التقرير ٨ صفحات). |
| الفريق العامل | كيميوسر / نجلاء محمد عبد المنعم كيميوسر / منيرة عبد الرحيم اسماعيل كيميوسر / هيام سيد محمود كيميوسر / نهى سمير ربيع هندسة مساعدة / أحمد سيد ابراهيم هندسة مساعد / فاطمة الزهراء فكري الكيميوسر / عمرو عبد الرحمن شافعي اد/ مصطفى زكى مصطفى اد/ أبو القحوح عبد المنعم عبد الحكيم |
| القانون بالتشغيل والاختبارات | الاستاذ الدكتور / مصطفى زكى مصطفى رئيس مجلس إدارة وحدة التحاليل والخدمات العلمية - معمل اختبار المواد ورئيس قسم السيراميك والبلاستيك والمواد الحطبة وممثل الإدارة العليا وصاحب الجودة بالوحدة |
| أشرف | ٢٠١٧/٩/٧ |
| المدير المسئول | كل الاختبارات قد تمت عند ٢٣ °م ودرجة رطوبة ٥٠ - ٦٠% مع إجراء جميع المعالجات اللازمة لأجهزة القياس بصفة دائمة ومستمرة |
| ظروف التشغيل والاختبار | |

شارع التحرير - الدقي - القاهرة
٢٣٣٧٨٠٢ مياثر ١٢٢١
١٠٨٤ فاكس
E-mail: nrc1302a@yahoo.com

المادة / شركة جامبو للصناعات البلاستيكية (أبو غالي)

تحية طيبة وبعد ...
بالإشارة إلى خطابكم فوارد بتاريخ ٢٠١٧ / ٨ / ٢١ بشأن إجراء الاختبارات التالية على عينة كوع UPVC قطر ١٠٠ مم ذات لون أبيض . طبقا للمواصفة الأمريكية ASTM D1784 , D2241 , D2665 . وكانت الاختبارات كالتالي :
١- اختبار الفحص الظاهري .
٢- اختبار الأبعاد .
٣- اختبار درجة حرارة التحول تحت ثقل .
٤- اختبار الكثافة .
٥- اختبار قوة التحمل للتشد قبل وبعد المعالجة .
٦- اختبار قوة التحمل للصدمة قبل وبعد المعالجة .
٧- اختبار تأثير الكبريتات .
٨- اختبار تأثير الأشعة فوق البنفسجية لمدة ٥٠ ساعة .
ونقد تم الانتهاء من الاختبارات في ظروف التشغيل التالية :
(١) في قياس الخواص الميكانيكية استخدم جهاز GALDABINI-QUASAR 600-MADE IN Italy المزود بجهاز تسجيل ثرمو ميكسي بالإضافة إلى نظام تحكم ذاتي و معايرة الكترونية للضغط والوزن ومعايرة الجهاز يوميا أو بين خطوات الاختبارات و تلك لمعايرة الأحمال الناتجة .
(٢) استخدم فرن كهربائي طراز Memmert West Germany في الاختبارات الحرارية .
(٣) استخدم جهاز Impact Tester CS-137 في قياس قوة التحمل للصدمة .
(٤) استخدم مقاييس دقة ٠.٠٠٠٦ مم في قياس أبعاد العينات .
(٥) استخدم جهاز تراسة تعجيل الضغوط الجوة من طراز Fadeometer .
(٦) استخدم ميزان حساس لأربعة أرقام عشرية ± ٠.٠٠٠١ جم طراز Chyo JK 150 .
(٧) استخدم جهاز RR (HDV 4/029 - England Vicat Softening point) طراز Ray Ran HDT-Vicat .
(٨) علما بأن جميع الأجهزة المستخدمة معايرة .
و فيما يلي جميع النتائج العلمية للاختبارات التي تمت على العينات الواردة علما بأن هذه النتائج تبتل نقدا العينات الواردة إلى قسم السيراميك والبلاستيك والمواد الحطبة بمعمل اختبار المواد بالمركز القومي للبحوث

شارع التحرير - الدقي - القاهرة
٢٣٣٧٨٠٢ مياثر ١٢٢١
١٠٨٤ فاكس
E-mail: nrc1302a@yahoo.com

NATIONAL RESEARCH CENTRE
TAHRIR St. DOKKI, CAIRO, EGYPT
Central Unit For Analysis And
Scientific Services (CUASS)
Material Test Lab.

المركز القومي للبحوث
القاهرة - جمهورية مصر العربية
وحدة التحاليل والخدمات العلمية المركزية
معمل اختبار المواد

نتائج اختبار الفحص الظاهري

على عينة كوع UPVC قطر ١٠٠ مم ذو لون أبيض

من إنتاج شركة جامبو للصناعات البلاستيكية (أبو غالي)



المسك = ٠.٤ مم
القطر الداخلي = ١٠.٧ مم
القطر الخارجي = ١٢.١ مم

عينة كوع ذو لون أبيض خالية من الشقوق والفجوات من الداخل والخارج و لا يوجد بها أي عيوب ظاهرة من تشققات أو تشوهات على طول جسم العينة من إنتاج أبو غالي .

شارع التحرير - الدقي - القاهرة
٢٣٣٧٨٠٢ مياثر ١٢٢١
١٠٨٤ فاكس
E-mail: nrc1302a@yahoo.com

نتائج اختبار الكثافة النوعية

على عينة كوع UPVC قطر ١٠٠ مم ذو لون أبيض

من إنتاج شركة جامبو للصناعات البلاستيكية (أبو غالي)

| م | وزن العينة في الهواء (جم) | وزن العينة + الماء في السائل (جم) | وزن الكثافة النوعية (جم/سم ^٣) |
|---|---------------------------|-----------------------------------|---|
| ١ | ٥,٤٧٣٥ | ١,٨٥٥٥ | ١,٤٩٥٨ |
| ٢ | ٥,٣٢٤٠ | ١,٨٠٣٥ | ١,٤٩٤٨ |

متوسط الكثافة النوعية = ١,٤٩٥٣ (جم/سم^٣)

* هذه القيمة حدودها في المواصفات قيمة استرشادية فقط لنوع المواد المستخدمة وحجم حبيباتها وقيمة الضغط المستخدم في الإنتاج .

نتائج اختبار درجة حرارة الحيوذ تحت ثقل (HDT)


* درجة الحرارة (HDT) تساوي ٧٦,٥ م تحت حمل ١,٨٢ نيوتن/سم^٢

نتائج اختبار الإحمض بالغمر في حمض الكبريتيك بتركيز ٩٣,٥ % لمدة ٧٢ ساعة

* لم يحدث بالعينة المختبرة أي تشقق أو تغير في اللون .

نتائج اختبار الإحمض بالغمر في حمض الكبريتيك بتركيز ٨٠ % لمدة ٧ أيام

* لم يحدث بالعينة المختبرة أي تشقق أو تغير في اللون .



٢٢٢٧١٦١٥ - ٢٢٢٧١٦١٥ داخلي ١٢٢١ مياشتر ٢٢٢٨٧٨٠٢ شارع التحرير - الدقي - القاهرة
٢٢٢٥٥١٩٢ - ٣٧٦٠٧٥٤١ وفاكس ١٠٨٤
E-mail: nrc1302a@yahoo.com

نتائج اختبار قوة التحمل للشد

على عينة كوع UPVC قطر ١٠٠ مم ذو لون أبيض

من إنتاج شركة جامبو للصناعات البلاستيكية (أبو غالي)

| م | قوة التحمل للشد قبل التعرض (نيوتن/سم ^٢) | قوة التحمل للشد بعد التعرض (نيوتن/سم ^٢) |
|---------|---|---|
| ١ | ٦٦٩,٢٦٤ | ٥٧٧,٨٤٦ |
| ٢ | ٥٣٠,٠٨٧ | ٥٤١,٨٢٠ |
| ٣ | ٥١١,١٨٣ | ٥٣٢,١١١ |
| المتوسط | ٥٧٠,١٧٨ | ٥٥٠,٥٩٢ |

نتائج اختبار قوة التحمل للصدمة

| م | قوة التحمل للصدمة قبل التعرض (كجم.سم/متر) | قوة التحمل للصدمة بعد التعرض (كجم.سم/متر) |
|---------|---|---|
| ١ | ٤٠٣,٩٦٩ | ٤٠٤,٢٥٥ |
| ٢ | ٤٠٦,٥٦٢ | ٤٠١,٤٠٨ |
| ٣ | ٤٠٢,٨٢٧ | ٤٠٢,٥٤٢ |
| المتوسط | ٤٠٤,٤٥٣ | ٤٠٢,٧٣٥ |

* التعرض للظروف الجوية المعجلة لمدة ٥٠ ساعة والمتمثلة في (الأشعة فوق البنفسجية U.V. + جو من الأوزون + رطوبة ٦٠ % + درجة حرار ٤٠ م)



٢٢٢٧١٦١٥ - ٢٢٢٧١٦١٥ داخلي ١٢٢١ مياشتر ٢٢٢٨٧٨٠٢ شارع التحرير - الدقي - القاهرة
٢٢٢٥٥١٩٢ - ٣٧٦٠٧٥٤١ وفاكس ١٠٨٤
E-mail: nrc1302a@yahoo.com

نتائج اختبار الظروف الجوية المعجلة بالتعرض للـ UV لمدة ٥٠ ساعة

على عينة كوع UPVC قطر ١٠٠ مم ذو لون أبيض

من إنتاج شركة جامبو للصناعات البلاستيكية (أبو غالى)

| العينة | قبل التعرض للظروف الجوية | بعد التعرض للظروف الجوية |
|------------|--------------------------|--------------------------|
| I. | ٨٩,٤٤ | ٨٩,٦١ |
| a | ٢,٩٠٠ | ٢,٣٥٠ |
| b | ٢,٨٢ | ٢,٣٨ |
| ΔE | | ١٠,٧٢٩ |

* يتعرض العينة للظروف الجوية المعجلة لمدة ٥٠ ساعة لم يحدث أى تغير فى اللون حيث أن ΔE أقل من الواحد الصحيح .



(٨١٥٦-٨/٦)

٢٢٢٧١٦١٥ - ٢٢٢٧١٦١٢ داخلى ١٢٢١ مباشر ٢٢٢٨٧٨٠٣ شارع التحرير - الدقى - القاهرة
٢٢٢٥٥١٩٢ - ٢٧٦٠٧٥٤١ فاكس ١٠٨٤
E-mail: nrc1302a@yahoo.com

ملخص عام للنتائج

على عينة كوع UPVC قطر ١٠٠ مم ذو لون أبيض

من إنتاج شركة جامبو للصناعات البلاستيكية (أبو غالى)

| م | الاختبارات | النتائج | حدود المواصفة ASTM D1784 |
|---|---|-----------------------------|--------------------------|
| ١ | نتائج اختبار الكثافة (جم/سم ^٣) | ١,٤٩٥٣ | ١,٤ |
| ٢ | نتائج اختبار درجة حرارة الحيوث تحت ثقل ١,٨٢ نيوتن/سم ^٢ (م ^٢) | ٧٦,٥ | ٧٠ |
| ٣ | نتائج اختبار الإحماض لمدة ٧٢ ساعة | لم يحدث أى تأثير على العينة | عدم حدوث تأثير |
| ٤ | نتائج اختبار الإحماض لمدة ٧ أيام | لم يحدث أى تأثير على العينة | عدم حدوث تأثير |
| ٥ | نتائج اختبار قوة التحمل للشد قبل التعرض (نيوتن /سم ^٢) | ٥٥,٩١٥ | ٤٨,٣ |
| ٦ | نتائج اختبار قوة التحمل للشد بعد التعرض (نيوتن /سم ^٢) | ٥٣,٩٩٥ | ٤٨,٣ |
| ٧ | نتائج اختبار قوة التحمل للصدمات قبل التعرض (جول /م ^٢) | ٣٩,٦٦٣ | ٣٤,٧ |
| ٨ | نتائج اختبار قوة التحمل للصدمات بعد التعرض (جول /م ^٢) | ٣٩,٤٩٥ | ٣٤,٧ |
| ٩ | نتائج اختبار تأثير الظروف الجوية المعجلة لمدة ٥٠ ساعة | لم يحدث تغير فى اللون | عدم حدوث تأثير |



(٨١٥٦-٨/٧)

٢٢٢٧١٦١٥ - ٢٢٢٧١٦١٢ داخلى ١٢٢١ مباشر ٢٢٢٨٧٨٠٣ شارع التحرير - الدقى - القاهرة
٢٢٢٥٥١٩٢ - ٢٧٦٠٧٥٤١ فاكس ١٠٨٤
E-mail: nrc1302a@yahoo.com

المركز القومي للبحوث
الدقي - القاهرة ، جمهورية مصر العربية
وحدة التحاليل والخدمات العلمية المركزية
معمل اختبار المواد

NATIONAL RESEARCH CENTRE
TAHRIR St. DOKKI, CAIRO, EGYPT
Central Unit For Analysis And
Scientific Services (CUASS)
Material Test Lab.

ولقد أعطى لكم هذا التقرير بناء على طلبكم ممثلاً فقط نتائج اختبار على عدد (١) عينة كروك UPVC قطر ١١٠ مم ذات لون أبيض ، والواردة من شركة جامبو للصناعات البلاستيكية (أبو غالي) ، ودون أدنى مسؤولية تجاه قسم السيراميك والبلاستيك والمواد الصلبة بمعمل اختبار المواد بالمركز القومي للبحوث في تحديد و انتقاء العينات المرسله للاختبار علماً بأن نتائج هذا التقرير تمثل فقط العينات و لا تشمل أى حال من الأحوال أى نوعية مماثلة ومخزنة ومشونة بمواقع التطبيق والتفسيخ والاستخدام ، ولا يجوز استخدام هذا التقرير فى الدعاية والإعلان عن المنتج المختبر إلا بعد الرجوع الى المركز القومي للبحوث والاتفاق على ذلك.

مع ملاحظة ألا يتم نقل وتصوير هذا التقرير بما يشمله من نتائج وإلا متكاملة وموافقة مسبقاً من قسم السيراميك والبلاستيك والمواد الصلبة بمعمل اختبار المواد بالمركز القومي للبحوث بالقاهرة.

رئيس مجلس إدارة وحدة التحاليل والخدمات العلمية
والمشرف على معمل اختبار المواد
أ.ع. مصطفى زكي مصطفى

(٨١٥٦-٨/٨)

داخلي ١٢٣١ مباشر ٣٣٣٨٧٨٠٣ شارع التحرير - الدقي - القاهرة
١٠٨٤ فاكس ٣٣٣٥٥١٩٢ - ٣٧٦٠٧٥٤١

E-mail: nrc1302a@yahoo.com

مركز تكنولوجيا البلاستيك

وزارة الصناعة والتجارة والتمويل والشؤون الاقتصادية
مجلس الصناعة للتكنولوجيا والابتكار

تقرير الاختبار
رقم: ٧٧٧

اسم العميل : جامبو للصناعات البلاستيكية .
تاريخ الإصدار : ٢٠١٦/١٢/٤ .
العينة : عدد (١) عينة جلبية PVC قطر ١٦٠ مم .
لون العينة : أبيض .
المواصفة : المصرية ١٧١٧ لسنة ٢٠٠٨ .
درجة الحرارة : ٢٣ ± ٢ °م .
الأجهزة المستخدمة :
- HDT-VICAT Tester (Ceast - Italy).
- Oven with forced convection (BINDER).

في حالة وجود أى شكوى رجاء الاتصال على رقم تليفون ٠٢/٥٠١٤١٩١ .
مدير عام الإدارة الفنية
(كيمياء / أمل عبد الرحمن)

مديرة المركز
مهندسة / نجوى المعطاش

تحريراً في ٢٠١٦/١٢/٤
بجى

مقر المعامل والتدريب : ش. جميلة بو حريد - السبوف شماعة - الإسكندرية . ت - ف / ٢٣٣٠٧٢٣٣ - ٢٣٣٢٥١١٢ .
مقر الإدارة : أمام ش. ركى عملا الله - ميدان الساعة - فيكتوريا - الإسكندرية . ت - ف / ٢٥٥١١٦ - ٢٥٠٢٥١١٦ .
ص.ب ١١ الإسكان الصناعى السبوف
البريد الإلكتروني Pto.ei@mfti.gov.eg

www.ettic.org/ptc

مركز تكنولوجيا البلاستيك

وزارة الصناعة والتجارة والتمويل والشؤون الاقتصادية
مجلس الصناعة للتكنولوجيا والابتكار

شهادة تحليل
رقم التقرير: (٧٧٧)

اسم العميل : جامبو للصناعات البلاستيكية .
تاريخ الإصدار : ٢٠١٦/١٢/٤ .
العينة : عدد (١) عينة جلبية PVC قطر ١٦٠ مم .
لون العينة : أبيض .
* العينة وبياناتها وردت إلى المركز بمعرفة العميل

| القياسات المرجعية | متوسط النتائج | | الاختبارات |
|---|---------------|--------------|------------|
| | ١٦٠ مم | ٧٨ | |
| ١- التأثير الحراري على الجلبة - فحص ظاهري - (٣٠ دقيقة) - نمية التغير | لم تتأثر | لا يوجد تغير | % |
| ٢- درجة حرارة التلين (فيكات) ٥٠ نيوتن ، ٥٠ م / ساعة | ٧٨ | ٧٨ | م |

الخلاصة
اجتازت العينة جلبية PVC قطر (١٦٠ مم) الاختبارات المذكورة أعلاه طبقاً للمواصفة المصرية ١٧١٧ لسنة ٢٠٠٨.

ملحوظة:
١- هذا التقرير يشير إلى العينة محل الاختبار فقط.
٢- هذا التقرير لا يتم نسخه مرة أخرى إلا كاملاً وبموافقة كتابية من مدير المركز.
مدير المعمل الميكانيكي
(كيمياء / معتز أحمد)
مدير إدارة المعامل
(كيمياء / وفاء على مرسى)
مهندس / إبراهيم مسعود

مقر المعامل والتدريب : ش. جميلة بو حريد - السبوف شماعة - الإسكندرية . ت - ف / ٢٣٣٠٧٢٣٣ - ٢٣٣٢٥١١٢ .
مقر الإدارة : أمام ش. ركى عملا الله - ميدان الساعة - فيكتوريا - الإسكندرية . ت - ف / ٢٥٥١١٦ - ٢٥٠٢٥١١٦ .
ص.ب ١١ الإسكان الصناعى السبوف
البريد الإلكتروني Pto.ei@mfti.gov.eg

www.ettic.org/ptc

NOTE

[illegible]

This image shows a full page of white paper with horizontal dotted lines. The lines are evenly spaced and run across the width of the page, providing a guide for handwriting practice. There are no margins, text, or other markings on the page.

THANK YOU



OHSAS 18001



ISO 9001





HEAD OFFICE الفرع الرئيسي

ش نجيب محفوظ متفرع من عباس العقاد مدينة نصر 28
28 Naguib mahfouz st., Nasr City, Cairo - Egypt

+2.0222718143

Customer Service خدمة العملاء

01004005551

Factories المصانع

دمياط الجديدة - المنطقة الصناعية بلوك (10-11)
New Damietta, industrial zone-Block (10&11)

الصلحية الجديدة - المنطقة الصناعية بلوك (H10)
New Salhia, first industrial zone, Block (10H)

info@aboughaly.com

www.aboughaly.com

f t y in / aboughalyco